

# **LEAD-BASED PAINT INSPECTION**

*for*

**PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL UNITS  
PLEASANT HILL, ILLINOIS**

*date of sampling:*

**APRIL 30 & MAY 1, 2013**

*table of contents:*

- ① **INTRODUCTION**
- ② **SUMMARY OF FINDINGS (POSITIVE MATERIALS)**
- ③ **XRF ANALYSIS SUMMARY**
- ④ **SITE PLAN(S)**
- ⑤ **INSPECTOR'S CREDENTIALS  
RADIOACTIVE MATERIAL LICENSE**

*consultant:*

**HINDS ENVIRONMENTAL, INC.  
2975 STANTON STREET  
SPRINGFIELD, ILLINOIS 62703  
(217) 585-8970 • FAX (217) 585-8879**

# **SECTION 1**

## INTRODUCTION

### A. APPLICABLE STANDARDS

This inspection report was developed in accordance with HUD/EPA standards for lead-based paint of 1.0 mg/cm<sup>2</sup> or 0.5% by weight as defined by Title X of the 1992 Housing and Community Development Act. Title X is also known as the Residential Lead-based Paint Hazard Reduction Act of 1992.

### B. PROTOCOL

#### INSPECTION PROTOCOL

The intent of this lead-based paint inspection was to inspect and identify lead-based paint on building component surfaces both on the interior and the exterior.

#### SAMPLING PROTOCOL

Lead-based paint sampling is done using a Niton XLp Spectrum Lead Detector (Model 300A) X-ray Fluorescence (XRF) instrument. This device uses a radioactive source that releases photons of energy onto a painted surface. The emitted photon causes a characteristic wavelength of energy to be released. The instrument then measures the energy release to determine if lead is present and at what amount. Substrate correction is not necessary with this instrument, and it can penetrate 20 layers of paint.

The lead summary of findings identifies building components that tested positive for lead-based paint. The XRF analysis sheets have identified testing areas. The sheets have reading number, then list component tested, substrate, side, condition, color, room, unit number and result. (Color listed is the visible color and may not be the color of the paint that contains lead.) No device at present can differentiate what layer or layers of paint on a surface actually is/are the layer or layers that contain lead. The results are reported as positive or negative in comparison to the standard of 1.0 mg/cm<sup>2</sup>. A negative result does not necessarily mean that no lead is present in the paint, but that the amount of lead in the paint is less than 1.0 mg/cm<sup>2</sup>.

# **SECTION 2**

**LEAD SUMMARY OF FINDINGS  
(POSITIVE MATERIALS)**

**PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL UNITS  
PLEASANT HILL, ILLINOIS**

**INTERIOR**

NO COMPONENT TESTED POSITIVE

**EXTERIOR**

ORIGINAL PAINTED WOOD COMPONENTS UNDER STEEL TRIM AND VINYL

# **SECTION 3**



PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading No	Component	Substrate	Side	Condition	Color	Room	Unit No.	Results	PbC
1	Self Calibrate								5.91
2	Calibrate								1
3	Calibrate								0.9
4	Calibrate								0.9
5	Wall	Gypsum	D	Intact	Ivory	Living Room	1	Negative	< LOD
6	Wall	Gypsum	A	Intact	Ivory	Living Room	1	Negative	< LOD
7	Wall	Gypsum	C	Intact	Ivory	Living Room	1	Negative	< LOD
8	Wall	Gypsum	B	Intact	Ivory	Living Room	1	Negative	< LOD
9	Window Sill	Wood	B	Intact	Ivory	Living Room	1	Negative	< LOD
10	Window Casing	Wood	B	Intact	Ivory	Living Room	1	Negative	< LOD
11	Window Sash	Vinyl	B	Intact	White	Living Room	1	Negative	< LOD
12	Baseboard	Wood	D	Intact	Ivory	Living Room	1	Negative	< LOD
13	Ceiling	Gypsum		Intact	Ivory	Living Room	1	Negative	< LOD
14	Wall	Gypsum	C	Intact	Ivory	Kitchen	1	Negative	< LOD
15	Wall	Gypsum	B	Intact	Ivory	Kitchen	1	Negative	< LOD
16	Wall	Gypsum	A	Intact	Ivory	Kitchen	1	Negative	< LOD
17	Wall	Gypsum	A	Intact	Ivory	Kitchen	1	Negative	< LOD
18	Window Casing	Wood	A	Intact	Ivory	Kitchen	1	Negative	< LOD
19	Window Sill	Wood	A	Intact	Ivory	Kitchen	1	Negative	< LOD
20	Window Sash	Vinyl	A	Intact	White	Kitchen	1	Negative	< LOD
21	Ceiling	Gypsum		Intact	Ivory	Kitchen	1	Negative	< LOD
22	Wall	Wood	B	Intact	Ivory	Kitchen	1	Negative	< LOD
23	Cabinet	Wood	D	Intact	Varnish	Kitchen	1	Negative	< LOD
24	Door	Wood	D	Intact	Varnish	Kitchen	1	Negative	< LOD
25	Door	Wood	C	Intact	Ivory	Kitchen	1	Negative	< LOD
26	Door Casing	Wood	C	Intact	Ivory	Kitchen	1	Negative	0.16
27	Wall	Gypsum	C	Intact	Ivory	Mechanical	1	Negative	< LOD
28	Wall	Gypsum	D	Intact	Ivory	Mechanical	1	Negative	< LOD
29	Wall	Gypsum	A	Intact	Ivory	Mechanical	1	Negative	< LOD
30	Wall	Gypsum	B	Intact	Ivory	Mechanical	1	Negative	< LOD
31	Shelf	Wood	B	Intact	Ivory	Mechanical	1	Negative	< LOD
32	Ceiling	Gypsum		Intact	Ivory	Mechanical	1	Negative	< LOD
33	Baseboard	Wood	A	Intact	Ivory	Mechanical	1	Negative	< LOD
34	Door	Wood	C	Intact	Ivory	Mechanical	1	Negative	< LOD
35	Door Casing	Wood	C	Intact	Ivory	Mechanical	1	Negative	< LOD
36	Door Stop	Wood	C	Intact	Ivory	Mechanical	1	Negative	< LOD
37	Door	Wood	C	Intact	Varnish	Mechanical	1	Negative	< LOD
38	Wall	Gypsum	C	Intact	Ivory	Bedroom	1	Negative	< LOD
39	Wall	Gypsum	D	Intact	Ivory	Bedroom	1	Negative	< LOD
40	Wall	Gypsum	A	Intact	Ivory	Bedroom	1	Negative	< LOD
41	Wall	Gypsum	B	Intact	Ivory	Bedroom	1	Negative	< LOD

**LOD = LIMIT OF DETECTION**

PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading #	Component	Substrate	Side	Condition	Color	Room	Unit #	Results	PbC
42	Window Sill	Wood	B	Intact	Ivory	Bedroom	1	Negative	< LOD
43	Window Stool	Wood	B	Intact	Ivory	Bedroom	1	Negative	< LOD
44	Window Sash	Vinyl	B	Intact	White	Bedroom	1	Negative	< LOD
45	Shelf	Wood	A	Intact	Ivory	Bathroom	1	Negative	< LOD
46	Wall	Gypsum	A	Intact	Ivory	Bathroom	1	Negative	< LOD
47	Wall	Gypsum	B	Intact	Ivory	Bathroom	1	Negative	< LOD
48	Wall	Gypsum	C	Intact	Ivory	Bathroom	1	Negative	< LOD
49	Wall	Gypsum	D	Intact	Ivory	Bathroom	1	Negative	< LOD
50	Chair Rail	Wood	B	Intact	Ivory	Bathroom	1	Negative	< LOD
51	Door	Wood	B	Intact	Varnish	Bathroom	1	Negative	< LOD
52	Door Jamb	Wood	B	Intact	Ivory	Bathroom	1	Negative	< LOD
53	Ceiling	Gypsum		Intact	Ivory	Bathroom	1	Negative	< LOD
54	Door	Metal	A	Intact	White	Exterior	A-4	Negative	< LOD
55	Door Jamb	Metal	A	Intact	White	Exterior	A-4	Negative	< LOD
56	Facia	Metal	a	Intact	White	Exterior	A-4	Negative	< LOD
57	Column	Metal	A	Intact	White	Exterior	A-4	Negative	< LOD
58	Ceiling	Metal		Intact	Gray	Exterior	A-4	Negative	< LOD
59	Casing	Metal	A	Intact	Ivory	Exterior	A-4	Negative	< LOD
60	Wall	Block	A	Peeling	Ivory	Exterior	A-4	Negative	< LOD
61	Downspout	Metal	D	Intact	Ivory	Exterior	A-4	Negative	< LOD
62	Column	Metal	C	Intact	Ivory	Exterior	A-4	Negative	< LOD
63	Wall	Gypsum	D	Intact	Ivory	Living Room	5	Negative	< LOD
64	Wall	Gypsum	C	Intact	Ivory	Living Room	5	Negative	< LOD
65	Wall	Gypsum	B	Intact	Ivory	Living Room	5	Negative	< LOD
66	Wall	Gypsum	A	Intact	Ivory	Living Room	5	Negative	< LOD
67	Ceiling	Gypsum		Intact	Ivory	Living Room	5	Negative	< LOD
68	Baseboard	Wood	D	Intact	Ivory	Living Room	5	Negative	< LOD
69	Wall	Wood	D	Intact	Ivory	Living Room	5	Negative	< LOD
70	Door	Metal	A	Intact	White	Living Room	5	Negative	< LOD
71	Door Jamb	Metal	A	Intact	White	Living Room	5	Negative	< LOD
72	Door	Wood	C	Intact	White	Living Room	5	Negative	< LOD
73	Door Casing	Wood	C	Intact	Ivory	Living Room	5	Negative	< LOD
74	Window Sill	Wood	C	Intact	Ivory	Living Room	5	Negative	< LOD
75	Window Casing	Wood	C	Intact	Ivory	Living Room	5	Negative	< LOD
76	Window Sash	Vinyl	B	Intact	White	Living Room	5	Negative	< LOD
77	Wall	Gypsum	D	Intact	Ivory	Kitchen	5	Negative	< LOD
78	Wall	Gypsum	B	Intact	Ivory	Kitchen	5	Negative	< LOD
79	Wall	Gypsum	C	Intact	Ivory	Kitchen	5	Negative	< LOD
80	Wall	Gypsum	A	Intact	Ivory	Kitchen	5	Negative	0.14
81	Ceiling	Gypsum		Intact	Ivory	Kitchen	5	Negative	< LOD
82	Door	Wood	D	Intact	Varnish	Kitchen	5	Negative	< LOD

**LOD = LIMIT OF DETECTION**



PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading No	Component	Substrate	Side	Condition	Color	Room	Unit No.	Results	PbC
83	Cabinet	Wood	D	Intact	Varnish	Kitchen	5	Negative	< LOD
84	Door Casing	Wood	A	Intact	Ivory	Mechanical	5	Negative	< LOD
85	Door	Wood	A	Intact	White	Mechanical	5	Negative	< LOD
86	Wall	Gypsum	D	Intact	Ivory	Mechanical	5	Negative	< LOD
87	Wall	Gypsum	C	Intact	Ivory	Mechanical	5	Negative	0.04
88	Wall	Gypsum	B	Intact	Ivory	Mechanical	5	Negative	< LOD
89	Wall	Gypsum	A	Intact	Ivory	Mechanical	5	Negative	< LOD
90	Ceiling	Gypsum		Intact	Ivory	Mechanical	5	Negative	< LOD
91	Shelf	Wood		Intact	Ivory	Mechanical	5	Negative	< LOD
92	Wall	Gypsum	D	Intact	Ivory	Bedroom	5	Negative	< LOD
93	Wall	Gypsum	C	Intact	Ivory	Bedroom	5	Negative	< LOD
94	Wall	Gypsum	B	Intact	Ivory	Bedroom	5	Negative	< LOD
95	Wall	Gypsum	A	Intact	Ivory	Bedroom	5	Negative	< LOD
96	Ceiling	Gypsum		Intact	Ivory	Bedroom	5	Negative	< LOD
97	Door Jamb	Wood	D	Intact	Ivory	Bedroom	5	Negative	< LOD
98	Door	Wood	D	Intact	Ivory	Bedroom	5	Negative	< LOD
99	Shelf	Wood	D	Intact	Ivory	Bedroom	5	Negative	< LOD
100	Window Sill	Wood	B	Intact	Ivory	Bedroom	5	Negative	< LOD
101	Parting Bead	Wood	B	Intact	Ivory	Bedroom	5	Negative	< LOD
102	Window Sash	Vinyl	B	Intact	White	Bedroom	5	Negative	< LOD
103	Door Jamb	Wood	B	Intact	Ivory	Bathroom	5	Negative	< LOD
104	Door	Wood	B	Intact	Varnish	Bathroom	5	Negative	< LOD
105	Wall	Gypsum	D	Intact	Ivory	Bathroom	5	Negative	< LOD
106	Wall	Gypsum	A	Intact	Ivory	Bathroom	5	Negative	< LOD
107	Wall	Gypsum	B	Intact	Ivory	Bathroom	5	Negative	0.13
108	Wall	Gypsum	C	Intact	Ivory	Bathroom	5	Negative	< LOD
109	Ceiling	Gypsum		Intact	Ivory	Bathroom	5	Negative	< LOD
110	Chair rail	Wood	A	Intact	White	Bathroom	5	Negative	< LOD
111	Trim	Metal	A	Intact	White	Exterior	B-2	Negative	< LOD
112	Column	Metal	A	Intact	White	Exterior	B-2	Negative	< LOD
113	Ceiling	Metal	A	Intact	White	Exterior	B-2	Negative	< LOD
114	Wall	Block	A	Intact	Gray	Exterior	B-2	Negative	< LOD
115	Downspout	Metal	A	Intact	White	Exterior	B-2	Negative	< LOD
116	Wall	Gypsum	A	Intact	Ivory	Living Room	6	Negative	< LOD
117	Wall	Gypsum	B	Intact	Ivory	Living Room	6	Negative	< LOD
118	Wall	Gypsum	C	Intact	Ivory	Living Room	6	Negative	< LOD
119	Wall	Gypsum	D	Intact	Ivory	Living Room	6	Negative	< LOD
120	Ceiling	Gypsum		Intact	Ivory	Living Room	6	Negative	< LOD
121	Wall	Wood	B	Intact	Ivory	Living Room	6	Negative	< LOD
122	Base	Wood	B	Intact	Ivory	Living Room	6	Negative	< LOD
123	Window Sill	Wood	D	Intact	Ivory	Living Room	6	Negative	< LOD

LOD = LIMIT OF DETECTION

PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading No	Component	Substrate	Side	Condition	Color	Room	Unit No.	Results	PbC
124	Parting Bead	Wood	D	Intact	Ivory	Living Room	6	Negative	< LOD
125	Window Sash	Vinyl	D	Intact	White	Living Room	6	Negative	< LOD
126	Door Casing	Wood	C	Intact	Ivory	Living Room	6	Negative	< LOD
127	Door	Wood	C	Intact	Ivory	Living Room	6	Negative	< LOD
128	Wall	Gypsum	A	Intact	Ivory	Kitchen	6	Negative	< LOD
130	Wall	Gypsum	B	Intact	Ivory	Kitchen	6	Negative	< LOD
131	Wall	Gypsum	C	Intact	Ivory	Kitchen	6	Negative	< LOD
132	Ceiling	Gypsum	D	Intact	Ivory	Kitchen	6	Negative	< LOD
133	Door	Wood	B	Intact	Varnish	Kitchen	6	Negative	< LOD
134	Cabinet	Wood	B	Intact	Varnish	Kitchen	6	Negative	< LOD
135	Window Sill	Wood	A	Intact	Ivory	Kitchen	6	Negative	< LOD
136	Window Sash	Wood	A	Intact	White	Kitchen	6	Negative	< LOD
137	Wall	Gypsum	A	Intact	Ivory	Mechanical	6	Negative	< LOD
138	Wall	Gypsum	B	Intact	Ivory	Mechanical	6	Negative	< LOD
139	Wall	Gypsum	C	Intact	Ivory	Mechanical	6	Negative	< LOD
140	Wall	Gypsum	D	Intact	Ivory	Mechanical	6	Negative	< LOD
141	Ceiling	Gypsum		Intact	Ivory	Mechanical	6	Negative	< LOD
142	Shelf	Wood	C	Intact	Ivory	Mechanical	6	Negative	< LOD
143	Trim	Wood	C	Intact	Ivory	Mechanical	6	Negative	< LOD
144	Base	Wood	A	Intact	Ivory	Mechanical	6	Negative	< LOD
145	Wall	Gypsum	A	Intact	Ivory	Bedroom	6	Negative	< LOD
146	Wall	Gypsum	B	Intact	Ivory	Bedroom	6	Negative	< LOD
147	Wall	Gypsum	C	Intact	Ivory	Bedroom	6	Negative	< LOD
148	Wall	Gypsum	D	Intact	Ivory	Bedroom	6	Negative	< LOD
149	Ceiling	Gypsum		Intact	Ivory	Bedroom	6	Negative	< LOD
150	Cabinet	Wood	A	Intact	Ivory	Bedroom	6	Negative	< LOD
151	Door	Wood	A	Intact	Ivory	Bedroom	6	Negative	< LOD
152	Shelf	Wood	A	Intact	Ivory	Bedroom	6	Negative	< LOD
153	Support	Wood	A	Intact	Ivory	Bedroom	6	Negative	< LOD
154	Sill	Wood	D	Intact	Ivory	Bedroom	6	Negative	< LOD
155	Parting Bead	Wood	D	Intact	Ivory	Bedroom	6	Negative	< LOD
156	Window Sash	Wood	D	Intact	White	Bedroom	6	Negative	< LOD
157	Wall	Gypsum	A	Intact	Ivory	Bathroom	6	Negative	< LOD
158	Wall	Gypsum	B	Intact	Ivory	Bathroom	6	Negative	< LOD
159	Wall	Gypsum	C	Intact	Ivory	Bathroom	6	Negative	< LOD
160	Wall	Gypsum	D	Intact	Ivory	Bathroom	6	Negative	< LOD
161	Ceiling	Gypsum		Intact	Ivory	Bathroom	6	Negative	< LOD
162	Chair rail	Wood	B	Intact	Ivory	Bathroom	6	Negative	< LOD
163	Door Jamb	Wood	D	Intact	Ivory	Bathroom	6	Negative	< LOD
164	Door	Wood	D	Intact	Varnish	Bathroom	6	Negative	< LOD
165	Wall	Gypsum	C	Intact	Ivory	Living Room	8	Negative	< LOD

LOD = LIMIT OF DETECTION

PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading No	Component	Substrate	Side	Condition	Color	Room	Unit No.	Results	PbC
166	Wall	Gypsum	D	Intact	Ivory	Living Room	8	Negative	< LOD
167	Wall	Gypsum	A	Intact	Ivory	Living Room	8	Negative	< LOD
168	Wall	Gypsum	B	Intact	Ivory	Living Room	8	Negative	< LOD
169	Ceiling	Gypsum		Intact	Ivory	Living Room	8	Negative	< LOD
170	Window Sill	Wood	C	Intact	Ivory	Living Room	8	Negative	< LOD
171	Window Sash	Vinyl	C	Intact	White	Living Room	8	Negative	< LOD
172	Window Stop	Wood	C	Intact	Ivory	Living Room	8	Negative	< LOD
173	Door Casing	Wood	A	Intact	Ivory	Living Room	8	Negative	< LOD
174	Door	Wood	A	Intact	Ivory	Living Room	8	Negative	< LOD
175	Shelf	Wood	A	Intact	Ivory	Living Room	8	Negative	< LOD
176	Base	Wood	D	Intact	Ivory	Living Room	8	Negative	< LOD
177	Wall	Gypsum	D	Intact	Ivory	Living Room	8	Negative	< LOD
178	Wall	Gypsum	A	Intact	Ivory	Kitchen	8	Negative	< LOD
179	Wall	Gypsum	B	Intact	Ivory	Kitchen	8	Negative	0.16
180	Wall	Gypsum	C	Intact	Ivory	Kitchen	8	Negative	< LOD
181	Wall	Gypsum	D	Intact	Ivory	Kitchen	8	Negative	< LOD
182	Ceiling	Gypsum		Intact	Ivory	Kitchen	8	Negative	< LOD
183	Door	Wood	B	Intact	Varnish	Kitchen	8	Negative	< LOD
184	Cabinet	Wood	B	Intact	Varnish	Kitchen	8	Negative	< LOD
185	Door Jamb	Wood	C	Intact	Ivory	Mechanical	8	Negative	< LOD
186	Door	Wood	C	Intact	Ivory	Mechanical	8	Negative	< LOD
187	Wall	Gypsum	D	Intact	Ivory	Mechanical	8	Negative	< LOD
188	Wall	Gypsum	A	Intact	Ivory	Mechanical	8	Negative	< LOD
189	Wall	Gypsum	B	Intact	Ivory	Mechanical	8	Negative	< LOD
190	Wall	Gypsum	C	Intact	Ivory	Mechanical	8	Negative	< LOD
191	Ceiling	Gypsum		Intact	Ivory	Mechanical	8	Negative	< LOD
192	Shelf	Wood	A	Intact	Ivory	Mechanical	8	Negative	< LOD
193	Base	Wood	C	Intact	Ivory	Mechanical	8	Negative	< LOD
194	Door Jamb	Wood	C	Intact	Ivory	Bedroom	8	Negative	< LOD
195	Door	Wood	C	Intact	Varnish	Bedroom	8	Negative	< LOD
196	Door Casing	Wood	B	Intact	Ivory	Bedroom	8	Negative	< LOD
197	Door	Wood	B	Intact	White	Bedroom	8	Negative	< LOD
198	Wall	Gypsum	A	Intact	Ivory	Bedroom	8	Negative	< LOD
199	Wall	Gypsum	B	Intact	Ivory	Bedroom	8	Negative	< LOD
200	Wall	Gypsum	C	Intact	Ivory	Bedroom	8	Negative	< LOD
201	Wall	Gypsum	D	Intact	Ivory	Bedroom	8	Negative	< LOD
202	Ceiling	Gypsum		Intact	Ivory	Bedroom	8	Negative	< LOD
203	Shelf Support	Wood	C	Intact	Ivory	Bedroom	8	Negative	< LOD
204	Window Casing	Wood	D	Intact	Ivory	Bedroom	8	Negative	< LOD
205	Window Sill	Wood	D	Intact	Ivory	Bedroom	8	Negative	< LOD
206	Window Sash	Vinyl	D	Intact	White	Bedroom	8	Negative	< LOD

LOD = LIMIT OF DETECTION

PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading No	Component	Substrate	Side	Condition	Color	Room	Unit No.	Results	PbC
207	Door Stop	Wood	D	Intact	Ivory	Bathroom	8	Negative	< LOD
208	Door	Wood	D	Intact	Varnish	Bathroom	8	Negative	< LOD
209	Wall	Gypsum	A	Intact	Ivory	Bathroom	8	Negative	< LOD
210	Wall	Gypsum	B	Intact	Ivory	Bathroom	8	Negative	< LOD
211	Wall	Gypsum	C	Intact	Ivory	Bathroom	8	Negative	< LOD
212	Wall	Gypsum	D	Intact	Ivory	Bathroom	8	Negative	< LOD
213	Ceiling	Gypsum		Intact	Ivory	Bathroom	8	Negative	< LOD
214	Chair Rail	Wood	D	Intact	Ivory	Bathroom	8	Negative	< LOD
215	Wall	Gypsum	A	Intact	Ivory	Living Room	9	Negative	< LOD
216	Wall	Gypsum	B	Intact	Ivory	Living Room	9	Negative	< LOD
217	Wall	Gypsum	C	Intact	Ivory	Living Room	9	Negative	< LOD
218	Wall	Gypsum	D	Intact	Ivory	Living Room	9	Negative	< LOD
219	Ceiling	Gypsum		Intact	Ivory	Living Room	9	Negative	< LOD
220	Window Sill	Wood	B	Intact	Ivory	Living Room	9	Negative	< LOD
221	Window Sash	Vinyl	B	Intact	White	Living Room	9	Negative	< LOD
222	Window Casing	Wood	D	Intact	Ivory	Living Room	9	Negative	< LOD
223	Shelf	Wood	D	Intact	Ivory	Living Room	9	Negative	< LOD
224	Door	Wood	D	Intact	White	Living Room	9	Negative	< LOD
225	Door	Wood	D	Intact	White	Living Room	9	Negative	< LOD
226	Door	Metal	A	Intact	White	Living Room	9	Negative	< LOD
227	Door Jamb	Metal	A	Intact	White	Living Room	9	Negative	< LOD
228	Wall	Gypsum	D	Intact	Ivory	Kitchen	9	Negative	0.09
229	Wall	Gypsum	C	Intact	Ivory	Kitchen	9	Negative	< LOD
230	Wall	Gypsum	B	Intact	Ivory	Kitchen	9	Negative	< LOD
231	Wall	Gypsum	A	Intact	Ivory	Kitchen	9	Negative	< LOD
232	Ceiling	Gypsum		Intact	Ivory	Kitchen	9	Negative	< LOD
233	Base	Wood	A	Intact	Ivory	Kitchen	9	Negative	< LOD
234	Wall	Wood	A	Intact	Ivory	Kitchen	9	Negative	< LOD
235	Window Sill	Wood	B	Intact	Ivory	Kitchen	9	Negative	< LOD
236	Window Sash	Vinyl	B	Intact	White	Kitchen	9	Negative	< LOD
237	Drawer	Wood	D	Intact	Varnish	Kitchen	9	Negative	< LOD
238	Cabinet	Wood	D	Intact	Varnish	Kitchen	9	Negative	< LOD
239	Door	Metal	C	Intact	White	Kitchen	9	Negative	< LOD
240	Door Casing	Wood	C	Intact	Ivory	Bedroom	9	Negative	< LOD
241	Wall	Gypsum	C	Intact	Ivory	Bedroom	9	Negative	< LOD
242	Wall	Gypsum	D	Intact	Ivory	Bedroom	9	Negative	< LOD
243	Wall	Gypsum	A	Intact	Ivory	Bedroom	9	Negative	< LOD
244	Wall	Gypsum	B	Intact	Ivory	Bedroom	9	Negative	< LOD
245	Ceiling	Gypsum		Intact	Ivory	Bedroom	9	Negative	< LOD
246	Door Casing	Wood	B	Intact	Ivory	Bedroom	9	Negative	< LOD
247	Door	Wood	B	Intact	Ivory	Bedroom	9	Negative	< LOD

LOD = LIMIT OF DETECTION



PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading No	Component	Substrate	Side	Condition	Color	Room	Unit No.	Results	PbC
248	Shelf Support	Wood	B	Intact	Ivory	Bedroom	9	Negative	< LOD
249	Parting Bead	Wood	A	Intact	Ivory	Bedroom	9	Negative	< LOD
250	Window Sash	Vinyl	A	Intact	Ivory	Bedroom	9	Negative	< LOD
251	Door Jamb	Wood	C	Intact	Ivory	Bedroom	9	Negative	< LOD
252	Door	Wood	C	Intact	Varnish	Bedroom	9	Negative	< LOD
253	Door Jamb	Wood	B	Intact	Ivory	Mechanical	9	Negative	< LOD
254	Door	Wood	B	Intact	Varnish	Mechanical	9	Negative	< LOD
255	Shelf	Wood	A	Intact	Ivory	Mechanical	9	Negative	< LOD
256	Wall	Gypsum	A	Intact	Ivory	Mechanical	9	Negative	< LOD
257	Wall	Gypsum	B	Intact	Ivory	Mechanical	9	Negative	< LOD
258	Wall	Gypsum	C	Intact	Ivory	Mechanical	9	Negative	< LOD
259	Wall	Gypsum	D	Intact	Ivory	Mechanical	9	Negative	< LOD
260	Ceiling	Gypsum		Intact	Ivory	Mechanical	9	Negative	< LOD
261	Trim	Wood		Intact	Ivory	Mechanical	9	Negative	< LOD
262	Base	Wood	C	Intact	Ivory	Mechanical	9	Negative	< LOD
263	Wall	Gypsum	C	Intact	Ivory	Bathroom	9	Negative	< LOD
264	Wall	Gypsum	D	Intact	Ivory	Bathroom	9	Negative	< LOD
265	Wall	Gypsum	A	Intact	Ivory	Bathroom	9	Negative	< LOD
266	Wall	Gypsum	B	Intact	Ivory	Bathroom	9	Negative	< LOD
267	Ceiling	Gypsum		Intact	Ivory	Bathroom	9	Negative	< LOD
268	Chair Rail	Wood	A	Intact	Ivory	Bathroom	9	Negative	< LOD
269	Door Jamb	Wood	A	Intact	Ivory	Bathroom	9	Negative	< LOD
270	Door	Wood	A	Intact	Varnish	Bathroom	9	Negative	< LOD
271	Shelf	Wood	B	Intact	Ivory	Bathroom	9	Negative	< LOD
272	Door Casing	Wood	B	Intact	Ivory	Bathroom	9	Negative	< LOD
273	Door	Wood	B	Intact	White	Bathroom	9	Negative	< LOD
274	Door Jamb	Wood	B	Intact	Ivory	Bedroom	9	Negative	< LOD
275	Door	Wood	B	Intact	Varnish	Bedroom	9	Negative	< LOD
276	Wall	Gypsum	B	Intact	Ivory	Bedroom	9	Negative	< LOD
277	Wall	Gypsum	C	Intact	Ivory	Bedroom	9	Negative	< LOD
278	Wall	Gypsum	D	Intact	Ivory	Bedroom	9	Negative	< LOD
279	Wall	Gypsum	A	Intact	Ivory	Bedroom	9	Negative	< LOD
280	Ceiling	Gypsum		Intact	Ivory	Bedroom	9	Negative	< LOD
281	Shelf	Wood	A	Intact	Ivory	Bedroom	9	Negative	< LOD
282	Door Casing	Wood	A	Intact	Ivory	Bedroom	9	Negative	< LOD
283	Door	Wood	A	Intact	White	Bedroom	9	Negative	< LOD
284	Window Stool	Wood	C	Intact	Ivory	Bedroom	9	Negative	< LOD
285	Window Sash	Vinyl	C	Intact	White	Bedroom	9	Negative	< LOD
286	Wall	Gypsum	A	Intact	Ivory	Living Room	10	Negative	< LOD
287	Wall	Gypsum	B	Intact	Ivory	Living Room	10	Negative	< LOD
288	Wall	Gypsum	C	Intact	Ivory	Living Room	10	Negative	< LOD

LOD = LIMIT OF DETECTION



PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading No	Component	Substrate	Side	Condition	Color	Room	Unit No.	Results	PbC
289	Wall	Gypsum	D	Intact	Ivory	Living Room	10	Negative	< LOD
290	Ceiling	Gypsum		Intact	Ivory	Living Room	10	Negative	< LOD
291	Door Casing	Wood	A	Intact	Ivory	Living Room	10	Negative	< LOD
292	Door	Metal	A	Intact	White	Living Room	10	Negative	< LOD
293	Door Casing	Wood	B	Intact	Ivory	Living Room	10	Negative	< LOD
294	Door	Wood	B	Intact	White	Living Room	10	Negative	< LOD
295	Shelf	Wood	B	Intact	Ivory	Living Room	10	Negative	< LOD
296	Base	Wood	C	Intact	Ivory	Living Room	10	Negative	< LOD
297	Wall	Wood	C	Intact	Ivory	Kitchen	10	Negative	0.06
298	Wall	Gypsum	A	Intact	Ivory	Kitchen	10	Negative	< LOD
299	Wall	Gypsum	B	Intact	Ivory	Kitchen	10	Negative	< LOD
300	Wall	Gypsum	C	Intact	Ivory	Kitchen	10	Negative	< LOD
301	Wall	Gypsum	D	Intact	Ivory	Kitchen	10	Negative	< LOD
302	Ceiling	Gypsum		Intact	Ivory	Kitchen	10	Negative	< LOD
303	Drawer	Wood	B	Intact	Varnish	Kitchen	10	Negative	< LOD
304	Cabinet	Wood	B	Intact	Varnish	Kitchen	10	Negative	< LOD
305	Door Casing	Wood	B	Intact	Ivory	Kitchen	10	Negative	< LOD
306	Door	Metal	C	Intact	White	Kitchen	10	Negative	< LOD
307	Window Sill	Wood	D	Intact	Ivory	Kitchen	10	Negative	< LOD
308	Window Casing	Wood	D	Intact	Ivory	Kitchen	10	Negative	< LOD
309	Window Sash	Vinyl	D	Intact	White	Kitchen	10	Negative	< LOD
310	Wall	Gypsum	A	Intact	Ivory	Bedroom	10	Negative	< LOD
311	Wall	Gypsum	B	Intact	Ivory	Bedroom	10	Negative	< LOD
312	Wall	Gypsum	C	Intact	Ivory	Bedroom	10	Negative	< LOD
313	Wall	Gypsum	D	Intact	Ivory	Bedroom	10	Negative	< LOD
314	Ceiling	Gypsum		Intact	Ivory	Bedroom	10	Negative	< LOD
315	Door Casing	Wood	D	Intact	Ivory	Bedroom	10	Negative	< LOD
316	Door	Wood	D	Intact	Ivory	Bedroom	10	Negative	< LOD
317	Shelf	Wood	D	Intact	Ivory	Bedroom	10	Negative	< LOD
318	Window Casing	Wood	A	Intact	Ivory	Bedroom	10	Negative	< LOD
319	Window Sash	Vinyl	A	Intact	White	Bedroom	10	Negative	< LOD
320	Wall	Gypsum	A	Intact	Ivory	Mechanical	10	Negative	< LOD
321	Wall	Gypsum	D	Intact	Ivory	Mechanical	10	Negative	< LOD
322	Wall	Gypsum	C	Intact	Ivory	Mechanical	10	Negative	< LOD
323	Ceiling	Gypsum		Intact	Ivory	Mechanical	10	Negative	0.05
324	Shelf	Wood	A	Intact	Ivory	Mechanical	10	Negative	< LOD
325	Door Jamb	Wood	D	Intact	Ivory	Mechanical	10	Negative	< LOD
326	Door	Wood	D	Intact	Varnish	Mechanical	10	Negative	< LOD
327	Base	Wood	D	Intact	Ivory	Mechanical	10	Negative	< LOD
328	Wall	Gypsum	A	Intact	Ivory	Bedroom	10	Negative	< LOD
329	Wall	Gypsum	B	Intact	Ivory	Bedroom	10	Negative	< LOD

LOD = LIMIT OF DETECTION

PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading No	Component	Substrate	Side	Condition	Color	Room	Unit No.	Results	PbC
330	Wall	Gypsum	C	Intact	Ivory	Bedroom	10	Negative	< LOD
331	Wall	Gypsum	D	Intact	Ivory	Bedroom	10	Negative	< LOD
332	Ceiling	Gypsum		Intact	Ivory	Bedroom	10	Negative	< LOD
333	Window Casing	Wood	C	Intact	Ivory	Bedroom	10	Negative	< LOD
334	Window Sash	Vinyl	C	Intact	White	Bedroom	10	Negative	< LOD
335	Door Casing	Wood	A	Intact	Ivory	Bedroom	10	Negative	< LOD
336	Door	Wood	A	Intact	White	Bedroom	10	Negative	< LOD
337	Shelf	Wood	A	Intact	Ivory	Bedroom	10	Negative	< LOD
338	Door Casing	Wood	D	Intact	Ivory	Bedroom	10	Negative	< LOD
339	Door	Wood	D	Intact	Varnish	Bedroom	10	Negative	< LOD
340	Door Casing	Wood	D	Intact	Ivory	Bathroom	10	Negative	< LOD
341	Door	Wood	D	Intact	Varnish	Bathroom	10	Negative	< LOD
342	Wall	Gypsum	A	Intact	Ivory	Bathroom	10	Negative	< LOD
343	Wall	Gypsum	B	Intact	Ivory	Bathroom	10	Negative	0.12
344	Wall	Gypsum	C	Intact	Ivory	Bathroom	10	Negative	< LOD
345	Wall	Gypsum	D	Intact	Ivory	Bathroom	10	Negative	0.11
346	Ceiling	Gypsum		Intact	Ivory	Bathroom	10	Negative	< LOD
347	Chair Rail	Wood	A	Intact	Ivory	Bathroom	10	Negative	< LOD
348	Fascia	Metal	A	Intact	White	Exterior	E-6	Negative	< LOD
349	Down Spout	Metal	A	Intact	White	Exterior	E-6	Negative	< LOD
350	Soffet	Metal	A	Intact	White	Exterior	E-6	Negative	< LOD
<b>351</b>	<b>Trim</b>	<b>Metal</b>	<b>D</b>	<b>Intact</b>	<b>White</b>	<b>Exterior</b>	<b>E-6</b>	<b>Positive</b>	<b>1</b>
352	Down Spout	Metal	A	Intact	White	Exterior	E-6	Negative	< LOD
353	Wall	Gypsum	A	Intact	Ivory	Living Room	11	Negative	< LOD
354	Wall	Gypsum	B	Intact	Ivory	Living Room	11	Negative	< LOD
355	Wall	Gypsum	C	Intact	Ivory	Living Room	11	Negative	< LOD
356	Wall	Gypsum	D	Intact	Ivory	Living Room	11	Negative	< LOD
357	Ceiling	Gypsum		Intact	Ivory	Living Room	11	Negative	< LOD
358	Door Casing	Wood	A	Intact	Ivory	Living Room	11	Negative	< LOD
359	Door	Metal	A	Intact	White	Living Room	11	Negative	< LOD
360	Door Casing	Wood	D	Intact	Ivory	Mechanical	11	Negative	< LOD
361	Door	Wood	D	Intact	White	Mechanical	11	Negative	< LOD
362	Wall	Gypsum	A	Intact	Ivory	Mechanical	11	Negative	< LOD
363	Wall	Gypsum	B	Intact	Ivory	Mechanical	11	Negative	< LOD
364	Wall	Gypsum	C	Intact	Ivory	Mechanical	11	Negative	< LOD
365	Wall	Gypsum	D	Intact	Ivory	Mechanical	11	Negative	< LOD
366	Ceiling	Gypsum		Intact	Ivory	Mechanical	11	Negative	< LOD
367	Base	Wood	A	Intact	Ivory	Mechanical	11	Negative	< LOD
368	Wall	Gypsum	A	Intact	Ivory	Kitchen	11	Negative	< LOD
369	Wall	Gypsum	D	Intact	Ivory	Kitchen	11	Negative	< LOD
370	Wall	Gypsum	C	Intact	Ivory	Kitchen	11	Negative	< LOD

LOD = LIMIT OF DETECTION

PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading No	Component	Substrate	Side	Condition	Color	Room	Unit No.	Results	PbC
371	Wall	Gypsum	B	Intact	Ivory	Kitchen	11	Negative	< LOD
372	Ceiling	Gypsum		Intact	Ivory	Kitchen	11	Negative	< LOD
373	Door Casing	Wood	C	Intact	Ivory	Kitchen	11	Negative	< LOD
374	Door	Metal	C	Intact	White	Kitchen	11	Negative	< LOD
375	Window Sill	Wood	C	Intact	Ivory	Kitchen	11	Negative	< LOD
376	Window Sash	Vinyl	C	Intact	White	Kitchen	11	Negative	< LOD
377	Door	Wood	D	Intact	Varnish	Kitchen	11	Negative	< LOD
378	Cabinet	Wood	D	Intact	Varnish	Kitchen	11	Negative	< LOD
379	Wall	Gypsum	B	Intact	Ivory	Bathroom	11	Negative	< LOD
380	Wall	Gypsum	C	Intact	Ivory	Bathroom	11	Negative	< LOD
381	Wall	Gypsum	D	Intact	Ivory	Bathroom	11	Negative	< LOD
382	Wall	Gypsum	A	Intact	Ivory	Bathroom	11	Negative	< LOD
383	Ceiling	Gypsum		Intact	Ivory	Bathroom	11	Negative	< LOD
384	Chair Rail	Wood	D	Intact	Ivory	Bathroom	11	Negative	< LOD
385	Door	Wood	D	Intact	Ivory	Bathroom	11	Negative	< LOD
386	Door Jamb	Wood	D	Intact	Ivory	Bathroom	11	Negative	< LOD
387	Wall	Gypsum	A	Intact	Ivory	Bedroom	11	Negative	< LOD
388	Wall	Gypsum	B	Intact	Ivory	Bedroom	11	Negative	< LOD
389	Wall	Gypsum	C	Intact	Ivory	Bedroom	11	Negative	< LOD
390	Wall	Gypsum	D	Intact	Ivory	Bedroom	11	Negative	< LOD
391	Ceiling	Gypsum		Intact	Ivory	Bedroom	11	Negative	< LOD
392	Window Casing	Wood	A	Intact	Ivory	Bedroom	11	Negative	< LOD
393	Window Sash	Vinyl	A	Intact	White	Bedroom	11	Negative	< LOD
394	Door Jamb	Wood	C	Intact	Ivory	Bedroom	11	Negative	< LOD
395	Door	Wood	C	Intact	Varnish	Bedroom	11	Negative	< LOD
396	Ceiling	Metal	A	Intact	White	Exterior	D-5	Negative	< LOD
397	Fascia	Metal	A	Intact	White	Exterior	D-5	Negative	< LOD
398	Trim	Metal	A	Intact	White	Exterior	D-5	Negative	< LOD
399	Wall	Gypsum	A	Intact	Ivory	Living Room	12	Negative	< LOD
400	Wall	Gypsum	B	Intact	Ivory	Living Room	12	Negative	< LOD
401	Wall	Gypsum	C	Intact	Ivory	Living Room	12	Negative	< LOD
402	Wall	Gypsum	D	Intact	Ivory	Living Room	12	Negative	< LOD
403	Ceiling	Gypsum		Intact	Ivory	Living Room	12	Negative	< LOD
404	Window Stool	Wood	D	Intact	Ivory	Living Room	12	Negative	< LOD
405	Window Sash	Vinyl	D	Intact	White	Living Room	12	Negative	< LOD
406	Window Casing	Wood	A	Intact	Ivory	Living Room	12	Negative	< LOD
407	Door	Wood	A	Intact	Ivory	Living Room	12	Negative	< LOD
408	Wall	Gypsum	A	Intact	Ivory	Kitchen	12	Negative	< LOD
409	Wall	Gypsum	B	Intact	Ivory	Kitchen	12	Negative	< LOD
410	Wall	Gypsum	C	Intact	Ivory	Kitchen	12	Negative	0.11
411	Wall	Gypsum	D	Intact	Ivory	Kitchen	12	Negative	< LOD

LOD = LIMIT OF DETECTION

PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading No	Component	Substrate	Side	Condition	Color	Room	Unit No.	Results	PbC
412	Ceiling	Gypsum		Intact	Ivory	Kitchen	12	Negative	< LOD
413	Window Casing	Wood	D	Intact	Ivory	Kitchen	12	Negative	< LOD
414	Window Sash	Vinyl	D	Intact	White	Kitchen	12	Negative	< LOD
415	Window Casing	Wood	C	Intact	Ivory	Kitchen	12	Negative	< LOD
416	Door	Wood	C	Intact	White	Kitchen	12	Negative	< LOD
417	Door	Wood	B	Intact	Varnish	Kitchen	12	Negative	< LOD
418	Cabinet	Wood	B	Intact	Varnish	Kitchen	12	Negative	< LOD
419	Wall	Gypsum	C	Intact	Ivory	Mechanical	12	Negative	< LOD
420	Wall	Gypsum	D	Intact	Ivory	Mechanical	12	Negative	< LOD
421	Wall	Gypsum	A	Intact	Ivory	Mechanical	12	Negative	< LOD
422	Wall	Gypsum	B	Intact	Ivory	Mechanical	12	Negative	< LOD
423	Ceiling	Gypsum		Intact	Ivory	Mechanical	12	Negative	< LOD
424	Trim	Wood	B	Intact	Ivory	Mechanical	12	Negative	< LOD
425	Shelf	Wood	A	Intact	Ivory	Mechanical	12	Negative	< LOD
426	Base	Wood	C	Intact	Ivory	Mechanical	12	Negative	< LOD
427	Wall	Gypsum	A	Intact	Ivory	Bathroom	12	Negative	< LOD
428	Wall	Gypsum	B	Intact	Ivory	Bathroom	12	Negative	< LOD
429	Wall	Gypsum	C	Intact	Ivory	Bathroom	12	Negative	< LOD
430	Wall	Gypsum	D	Intact	Ivory	Bathroom	12	Negative	< LOD
431	Ceiling	Gypsum		Intact	Ivory	Bathroom	12	Negative	< LOD
432	Chair Rail	Wood	A	Intact	Ivory	Bathroom	12	Negative	< LOD
433	Door Jamb	Wood	A	Intact	Ivory	Bathroom	12	Negative	< LOD
434	Door	Wood	A	Intact	Varnish	Bathroom	12	Negative	< LOD
435	Wall	Gypsum	A	Intact	Ivory	Bedroom	12	Negative	< LOD
436	Wall	Gypsum	B	Intact	Ivory	Bedroom	12	Negative	< LOD
437	Wall	Gypsum	C	Intact	Ivory	Bedroom	12	Negative	< LOD
438	Wall	Gypsum	D	Intact	Ivory	Bedroom	12	Negative	< LOD
439	Ceiling	Gypsum		Intact	Ivory	Bedroom	12	Negative	< LOD
440	Window Sill	Wood	A	Intact	Ivory	Bedroom	12	Negative	< LOD
441	Window Sash	Vinyl	A	Intact	White	Bedroom	12	Negative	< LOD
442	Window Stop	Wood	C	Intact	Ivory	Bedroom	12	Negative	< LOD
443	Door	Wood	C	Intact	Ivory	Bedroom	12	Negative	< LOD
444	Shelf	Wood	B	Intact	Ivory	Bedroom	12	Negative	< LOD
445	Door Casing	Wood	B	Intact	Ivory	Bedroom	12	Negative	< LOD
446	Door	Wood	B	Intact	Ivory	Bedroom	12	Negative	< LOD
447	Calibrate								1
448	Calibrate								0.9
449	Calibrate								1

LOD = LIMIT OF DETECTION



PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading #	Component	Substrate	Side	Condition	Color	Room	Unit #	Results	PbC
1	Self Calibrate								5.05
2	Calibrate								1
3	Calibrate								1
4	Calibrate								1
5	Wall	Gypsum	D	Intact	Ivory	Living Room	13	Negative	< LOD
6	Wall	Gypsum	A	Intact	Ivory	Living Room	13	Negative	< LOD
7	Wall	Gypsum	B	Intact	Ivory	Living Room	13	Negative	< LOD
8	Wall	Gypsum	C	Intact	Ivory	Living Room	13	Negative	< LOD
9	Ceiling	Gypsum		Intact	Ivory	Living Room	13	Negative	< LOD
10	Door Casing	Wood	D	Intact	Ivory	Living Room	13	Negative	< LOD
11	Door	Metal	D	Intact	White	Living Room	13	Negative	< LOD
12	Shelf	Wood	D	Intact	Ivory	Living Room	13	Negative	< LOD
13	Door Casing	Wood	A	Intact	Ivory	Living Room	13	Negative	< LOD
14	Door	Metal	A	Intact	White	Living Room	13	Negative	< LOD
15	Window Casing	Wood	B	Intact	Ivory	Living Room	13	Negative	< LOD
16	Window Sash	Vinyl	B	Intact	White	Living Room	13	Negative	< LOD
17	Base	Wood	C	Intact	Ivory	Living Room	13	Negative	< LOD
18	Wall	Gypsum	C	Intact	Ivory	Living Room	13	Negative	< LOD
19	Wall	Gypsum	D	Intact	Ivory	Kitchen	13	Negative	< LOD
20	Wall	Gypsum	C	Intact	Ivory	Kitchen	13	Negative	< LOD
21	Wall	Gypsum	B	Intact	Ivory	Kitchen	13	Negative	< LOD
22	Wall	Gypsum	A	Intact	Ivory	Kitchen	13	Negative	< LOD
23	Ceiling	Gypsum		Intact	Ivory	Kitchen	13	Negative	< LOD
24	Window Sill	Wood	B	Intact	Ivory	Kitchen	13	Negative	< LOD
25	Window Sash	Vinyl	B	Intact	White	Kitchen	13	Negative	< LOD
26	Door Casing	Wood	C	Intact	Ivory	Kitchen	13	Negative	< LOD
27	Door	Metal	C	Intact	White	Kitchen	13	Negative	< LOD
28	Door	Wood	D	Intact	Varnish	Kitchen	13	Negative	< LOD
29	Cabinet	Wood	D	Intact	Varnish	Kitchen	13	Negative	< LOD
30	Wall	Gypsum	A	Intact	Ivory	Mechanical	13	Negative	< LOD
31	Wall	Gypsum	B	Intact	Ivory	Mechanical	13	Negative	0.11
32	Wall	Gypsum	C	Intact	Ivory	Mechanical	13	Negative	< LOD
33	Wall	Gypsum	D	Intact	Ivory	Mechanical	13	Negative	< LOD
34	Ceiling	Gypsum		Intact	Ivory	Mechanical	13	Negative	< LOD
35	Trim	Wood		Intact	Ivory	Mechanical	13	Negative	< LOD
36	Shelf	Wood	A	Intact	Ivory	Mechanical	13	Negative	< LOD
37	Door Stop	Wood	B	Intact	Ivory	Mechanical	13	Negative	< LOD
38	Door	Wood	B	Intact	Ivory	Mechanical	13	Negative	< LOD
39	Base	Wood	C	Intact	Ivory	Mechanical	13	Negative	< LOD
40	Wall	Gypsum	A	Intact	Ivory	Bathroom	13	Negative	< LOD
41	Wall	Gypsum	B	Intact	Ivory	Bathroom	13	Negative	< LOD

LOD = LIMIT OF DETECTION



PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading #	Component	Substrate	Side	Condition	Color	Room	Unit #	Results	PbC
42	Wall	Gypsum	C	Intact	Ivory	Bathroom	13	Negative	< LOD
43	Wall	Gypsum	D	Intact	Ivory	Bathroom	13	Negative	< LOD
44	Ceiling	Gypsum		Intact	Ivory	Bathroom	13	Negative	< LOD
45	Chair Rail	Wood	D	Intact	Ivory	Bathroom	13	Negative	< LOD
46	Door Stop	Wood	A	Intact	Ivory	Bathroom	13	Negative	< LOD
47	Door	Wood	A	Intact	Varnish	Bathroom	13	Negative	< LOD
48	Wall	Gypsum	B	Intact	Ivory	Bedroom	13	Negative	< LOD
49	Wall	Gypsum	C	Intact	Ivory	Bedroom	13	Negative	< LOD
50	Wall	Gypsum	D	Intact	Ivory	Bedroom	13	Negative	< LOD
51	Wall	Gypsum	A	Intact	Ivory	Bedroom	13	Negative	< LOD
52	Ceiling	Gypsum		Intact	Ivory	Bedroom	13	Negative	< LOD
53	Door Casing	Wood	A	Intact	Ivory	Bedroom	13	Negative	< LOD
54	Door	Metal	A	Intact	White	Bedroom	13	Negative	< LOD
55	Shelf	Wood	A	Intact	Ivory	Bedroom	13	Negative	< LOD
56	Door Jamb	Wood	B	Intact	Ivory	Bedroom	13	Negative	< LOD
57	Door	Wood	B	Intact	Ivory	Bedroom	13	Negative	< LOD
58	Window Casing	Wood	C	Intact	Ivory	Bedroom	13	Negative	< LOD
59	Window Sash	Vinyl	C	Intact	White	Bedroom	13	Negative	< LOD
60	Wall	Gypsum	B	Intact	Ivory	Bedroom	13	Negative	< LOD
61	Wall	Gypsum	C	Intact	Ivory	Bedroom	13	Negative	< LOD
62	Wall	Gypsum	D	Intact	Ivory	Bedroom	13	Negative	< LOD
63	Wall	Gypsum	A	Intact	Ivory	Bedroom	13	Negative	< LOD
64	Ceiling	Gypsum		Intact	Ivory	Bedroom	13	Negative	< LOD
65	Door Stop	Wood	C	Intact	Ivory	Bedroom	13	Negative	< LOD
66	Door	Wood	C	Intact	Ivory	Bedroom	13	Negative	< LOD
67	Door Casing	Wood	B	Intact	Ivory	Bedroom	13	Negative	< LOD
68	Door	Metal	B	Intact	White	Bedroom	13	Negative	< LOD
69	Shelf	Wood	B	Intact	Ivory	Bedroom	13	Negative	< LOD
70	Window Casing	Wood	A	Intact	Ivory	Bedroom	13	Negative	< LOD
71	Window Sash	Vinyl	A	Intact	White	Bedroom	13	Negative	< LOD
72	Down Spout	Metal	A	Intact	White	Exterior	E-5	Negative	< LOD
73	Soffit	Metal	A	Intact	Ivory	Exterior	E-5	Negative	< LOD
74	Fascia	Metal	A	Intact	Ivory	Exterior	E-5	Negative	< LOD
75	Trim	Metal	A	Intact	Ivory	Exterior	E-5	Negative	< LOD
76	Wall	Gypsum	B	Intact	Ivory	Living Room	14	Negative	< LOD
77	Wall	Gypsum	C	Intact	Ivory	Living Room	14	Negative	< LOD
78	Wall	Gypsum	D	Intact	Ivory	Living Room	14	Negative	< LOD
79	Wall	Gypsum	A	Intact	Ivory	Living Room	14	Negative	< LOD
80	Ceiling	Gypsum		Intact	Ivory	Living Room	14	Negative	< LOD
81	Door Casing	Wood	A	Intact	Ivory	Living Room	14	Negative	< LOD
82	Door	Metal	A	Intact	White	Living Room	14	Negative	< LOD
83	Door Casing	Wood	B	Intact	Ivory	Living Room	14	Negative	< LOD

LOD = LIMIT OF DETECTION

PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading #	Component	Substrate	Side	Condition	Color	Room	Unit #	Results	PbC
84	Door	Metal	B	Intact	Ivory	Living Room	14	Negative	< LOD
85	Shelf	Wood	B	Intact	Ivory	Living Room	14	Negative	< LOD
86	Wall	Gypsum	A	Intact	Ivory	Kitchen	14	Negative	< LOD
87	Wall	Gypsum	B	Intact	Ivory	Kitchen	14	Negative	< LOD
88	Wall	Gypsum	C	Intact	Ivory	Kitchen	14	Negative	< LOD
89	Wall	Gypsum	D	Intact	Ivory	Kitchen	14	Negative	< LOD
90	Ceiling	Gypsum		Intact	Ivory	Kitchen	14	Negative	< LOD
91	Door Casing	Wood	C	Intact	Ivory	Kitchen	14	Negative	< LOD
92	Door	Metal	C	Intact	White	Kitchen	14	Negative	< LOD
93	Drawer	Wood	B	Intact	Varnish	Kitchen	14	Negative	< LOD
94	Cabinet	Wood	B	Intact	Varnish	Kitchen	14	Negative	< LOD
95	Wall	Gypsum	A	Intact	Ivory	Mechanical	14	Negative	< LOD
96	Wall	Gypsum	B	Intact	Ivory	Mechanical	14	Negative	< LOD
97	Wall	Gypsum	C	Intact	Ivory	Mechanical	14	Negative	< LOD
98	Wall	Gypsum	D	Intact	Ivory	Mechanical	14	Negative	< LOD
99	Ceiling	Gypsum		Intact	Ivory	Mechanical	14	Negative	< LOD
100	Shelf	Wood	A	Intact	Ivory	Mechanical	14	Negative	< LOD
101	Door Jamb	Wood	D	Intact	Ivory	Mechanical	14	Negative	< LOD
102	Door	Wood	D	Intact	Varnish	Mechanical	14	Negative	< LOD
103	Base	Wood	C	Intact	Ivory	Mechanical	14	Negative	< LOD
104	Wall	Gypsum	A	Intact	Ivory	Bathroom	14	Negative	< LOD
105	Wall	Gypsum	B	Intact	Ivory	Bathroom	14	Negative	< LOD
106	Wall	Gypsum	C	Intact	Ivory	Bathroom	14	Negative	< LOD
107	Wall	Gypsum	D	Intact	Ivory	Bathroom	14	Negative	< LOD
108	Ceiling	Gypsum		Intact	Ivory	Bathroom	14	Negative	< LOD
109	Chair Rail	Wood	A	Intact	Ivory	Bathroom	14	Negative	< LOD
110	Door Jamb	Wood	A	Intact	Ivory	Bathroom	14	Negative	0.11
111	Door	Wood	A	Intact	Varnish	Bathroom	14	Negative	< LOD
112	Wall	Gypsum	B	Intact	Ivory	Bedroom	14	Negative	< LOD
113	Wall	Gypsum	C	Intact	Ivory	Bedroom	14	Negative	< LOD
114	Wall	Gypsum	D	Intact	Ivory	Bedroom	14	Negative	< LOD
115	Wall	Gypsum	A	Intact	Ivory	Bedroom	14	Negative	< LOD
116	Ceiling	Gypsum		Intact	Ivory	Bedroom	14	Negative	< LOD
117	Window Casing	Wood	C	Intact	Ivory	Bedroom	14	Negative	0.12
118	Window Sash	Vinyl	C	Intact	White	Bedroom	14	Negative	< LOD
119	Door Casing	Wood	A	Intact	Ivory	Bedroom	14	Negative	< LOD
120	Door	Metal	A	Intact	White	Bedroom	14	Negative	< LOD
121	Shelf	Wood	A	Intact	Ivory	Bedroom	14	Negative	< LOD
122	Wall	Gypsum	A	Intact	Ivory	Bedroom	14	Negative	< LOD
123	Wall	Gypsum	B	Intact	Ivory	Bedroom	14	Negative	< LOD
124	Wall	Gypsum	C	Intact	Ivory	Bedroom	14	Negative	< LOD

LOD = LIMIT OF DETECTION

PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading #	Component	Substrate	Side	Condition	Color	Room	Unit #	Results	PbC
125	Wall	Gypsum	D	Intact	Ivory	Bedroom	14	Negative	< LOD
126	Ceiling	Gypsum		Intact	Ivory	Bedroom	14	Negative	< LOD
127	Window Casing	Wood	A	Intact	Ivory	Bedroom	14	Negative	< LOD
128	Window Sash	Vinyl	A	Intact	White	Bedroom	14	Negative	< LOD
129	Door Casing	Wood	D	Intact	Ivory	Bedroom	14	Negative	< LOD
130	Door	Metal	D	Intact	White	Bedroom	14	Negative	< LOD
131	Shelf	Wood	D	Intact	Ivory	Bedroom	14	Negative	< LOD
132	Door Jamb	Wood	C	Intact	Ivory	Bedroom	14	Negative	< LOD
133	Door	Wood	C	Intact	Ivory	Bedroom	14	Negative	< LOD
134	Siding	Vinyl	A	Intact	Gray	Exterior	E-5	Positive	1
135	Wall	Gypsum	B	Intact	Ivory	Kitchen	15	Negative	< LOD
136	Wall	Gypsum	C	Intact	Ivory	Kitchen	15	Negative	< LOD
137	Wall	Gypsum	D	Intact	Ivory	Kitchen	15	Negative	< LOD
138	Wall	Gypsum	A	Intact	Ivory	Kitchen	15	Negative	< LOD
139	Ceiling	Gypsum		Intact	Ivory	Kitchen	15	Negative	< LOD
140	Door Casing	Wood	B	Intact	Ivory	Kitchen	15	Negative	< LOD
141	Door	Metal	B	Intact	White	Kitchen	15	Negative	< LOD
142	Drawer	Wood	C	Intact	Varnish	Kitchen	15	Negative	< LOD
143	Cabinet	Wood	C	Intact	Varnish	Kitchen	15	Negative	< LOD
144	Base	Wood	D	Intact	Ivory	Kitchen	15	Negative	< LOD
145	Wall	Wood	D	Intact	Ivory	Kitchen	15	Negative	< LOD
146	Wall	Gypsum	A	Intact	Ivory	Living Room	15	Negative	< LOD
147	Wall	Gypsum	D	Intact	Ivory	Living Room	15	Negative	< LOD
148	Wall	Gypsum	C	Intact	Ivory	Living Room	15	Negative	< LOD
149	Wall	Gypsum	B	Intact	Ivory	Living Room	15	Negative	< LOD
150	Ceiling	Gypsum		Intact	Ivory	Living Room	15	Negative	< LOD
151	Door Jamb	Wood	A	Intact	Ivory	Living Room	15	Negative	< LOD
152	Door	Metal	A	Intact	White	Living Room	15	Negative	< LOD
153	Window Casing	Wood	A	Intact	Ivory	Living Room	15	Negative	< LOD
154	Window Sash	Vinyl	A	Intact	White	Living Room	15	Negative	< LOD
155	Wall	Gypsum	A	Intact	Ivory	Mechanical	15	Negative	< LOD
156	Wall	Gypsum	B	Intact	Ivory	Mechanical	15	Negative	< LOD
157	Wall	Gypsum	C	Intact	Ivory	Mechanical	15	Negative	< LOD
158	Wall	Gypsum	D	Intact	Ivory	Mechanical	15	Negative	< LOD
159	Ceiling	Gypsum		Intact	Ivory	Mechanical	15	Negative	< LOD
160	Shelf	Wood	A	Intact	Ivory	Mechanical	15	Negative	< LOD
161	Door Casing	Wood	D	Intact	Ivory	Mechanical	15	Negative	< LOD
162	Door	Wood	D	Intact	Ivory	Mechanical	15	Negative	< LOD
163	Wall	Gypsum	A	Intact	Ivory	Bathroom	15	Negative	< LOD
164	Wall	Gypsum	B	Intact	Ivory	Bathroom	15	Negative	< LOD
165	Wall	Gypsum	C	Intact	Ivory	Bathroom	15	Negative	< LOD

LOD = LIMIT OF DETECTION

PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading #	Component	Substrate	Side	Condition	Color	Room	Unit #	Results	PbC
166	Wall	Gypsum	D	Intact	Ivory	Bathroom	15	Negative	< LOD
167	Ceiling	Gypsum		Intact	Ivory	Bathroom	15	Negative	< LOD
168	Chair Rail	Wood	A	Intact	Ivory	Bathroom	15	Negative	< LOD
169	Window Casing	Wood	B	Intact	Ivory	Bathroom	15	Negative	< LOD
170	Window Sash	Vinyl	B	Intact	White	Bathroom	15	Negative	< LOD
171	Door Jamb	Wood	D	Intact	Ivory	Bathroom	15	Negative	< LOD
172	Door	Wood	D	Intact	Varnish	Bathroom	15	Negative	< LOD
173	Wall	Gypsum	A	Intact	Ivory	Bedroom	15	Negative	< LOD
174	Wall	Gypsum	D	Intact	Ivory	Bedroom	15	Negative	< LOD
175	Wall	Gypsum	C	Intact	Ivory	Bedroom	15	Negative	< LOD
176	Wall	Gypsum	B	Intact	Ivory	Bedroom	15	Negative	< LOD
177	Ceiling	Gypsum		Intact	Ivory	Bedroom	15	Negative	< LOD
178	Window Casing	Wood	B	Intact	Ivory	Bedroom	15	Negative	< LOD
179	Window Sash	Vinyl	B	Intact	White	Bedroom	15	Negative	< LOD
180	Door Jamb	Wood	D	Intact	Ivory	Bedroom	15	Negative	< LOD
181	Shelf	Wood	D	Intact	Ivory	Bedroom	15	Negative	< LOD
182	Door Stop	Wood	A	Intact	Ivory	Bedroom	15	Negative	< LOD
183	Door	Wood	A	Intact	Varnish	Bedroom	15	Negative	< LOD
184	Wall	Gypsum	B	Intact	Ivory	Bedroom	15	Negative	< LOD
185	Wall	Gypsum	C	Intact	Ivory	Bedroom	15	Negative	< LOD
186	Wall	Gypsum	D	Intact	Ivory	Bedroom	15	Negative	< LOD
187	Wall	Gypsum	A	Intact	Ivory	Bedroom	15	Negative	< LOD
188	Ceiling	Gypsum		Intact	Ivory	Bedroom	15	Negative	< LOD
189	Window Casing	Wood	D	Intact	Ivory	Bedroom	15	Negative	< LOD
190	Window Sash	Vinyl	D	Intact	White	Bedroom	15	Negative	< LOD
191	Shelf	Wood	B	Intact	Ivory	Bedroom	15	Negative	< LOD
192	Door Jamb	Wood	B	Intact	Ivory	Bedroom	15	Negative	< LOD
193	Door	Wood	B	Intact	Varnish	Bedroom	15	Negative	< LOD
194	Wall	Gypsum	B	Intact	Ivory	Bedroom	15	Negative	< LOD
195	Wall	Gypsum	C	Intact	Ivory	Bedroom	15	Negative	< LOD
196	Wall	Gypsum	D	Intact	Ivory	Bedroom	15	Negative	< LOD
197	Wall	Gypsum	A	Intact	Ivory	Bedroom	15	Negative	< LOD
198	Ceiling	Gypsum		Intact	Ivory	Bedroom	15	Negative	< LOD
199	Window Casing	Wood	D	Intact	Ivory	Bedroom	15	Negative	< LOD
200	Window Sash	Vinyl	D	Intact	White	Bedroom	15	Negative	< LOD
201	Shelf	Wood	B	Intact	Ivory	Bedroom	15	Negative	< LOD
202	Door Jamb	Wood	B	Intact	Ivory	Bedroom	15	Negative	< LOD
203	Door Jamb	Wood	B	Intact	White	Exterior	I-1	Negative	< LOD
204	Door	Wood	B	Intact	Ivory	Exterior	I-1	Negative	< LOD
205	Trim	Metal	A	Intact	Ivory	Exterior	I-1	Positive	1
206	Down Spout	Metal	B	Intact	Ivory	Exterior	I-1	Negative	< LOD

LOD = LIMIT OF DETECTION



PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading #	Component	Substrate	Side	Condition	Color	Room	Unit #	Results	PbC
207	Soffit	Metal	B	Intact	Ivory	Exterior	I-1	Negative	< LOD
208	Fascia	Metal	B	Intact	Ivory	Exterior	I-1	Negative	< LOD
209	Wall	Gypsum	B	Intact	Ivory	Living Room	16	Negative	< LOD
210	Wall	Gypsum	C	Intact	Ivory	Living Room	16	Negative	< LOD
211	Wall	Gypsum	D	Intact	Ivory	Living Room	16	Negative	< LOD
212	Wall	Gypsum	A	Intact	Ivory	Living Room	16	Negative	< LOD
213	Ceiling	Gypsum		Intact	Ivory	Living Room	16	Negative	< LOD
214	Window Casing	Wood	A	Intact	Ivory	Living Room	16	Negative	< LOD
215	Window Sash	Vinyl	A	Intact	Ivory	Living Room	16	Negative	< LOD
216	Door Casing	Wood	A	Intact	Ivory	Living Room	16	Negative	< LOD
217	Door	Wood	A	Intact	White	Living Room	16	Negative	< LOD
218	Stringer	Wood	B	Intact	Ivory	Living Room	16	Negative	< LOD
219	Wall	Gypsum	A	Intact	Ivory	Kitchen	16	Negative	< LOD
220	Wall	Gypsum	B	Intact	Ivory	Kitchen	16	Negative	< LOD
221	Wall	Gypsum	C	Intact	Ivory	Kitchen	16	Negative	< LOD
222	Wall	Gypsum	D	Intact	Ivory	Kitchen	16	Negative	< LOD
223	Ceiling	Gypsum		Intact	Ivory	Kitchen	16	Negative	< LOD
224	Drawer	Wood	D	Intact	Varnish	Kitchen	16	Negative	< LOD
225	Cabinet	Wood	D	Intact	Varnish	Kitchen	16	Negative	< LOD
226	Door Casing	Wood	C	Intact	Ivory	Kitchen	16	Negative	< LOD
227	Door	Metal	C	Intact	White	Kitchen	16	Negative	< LOD
228	Wall	Gypsum	D	Intact	Ivory	Mechanical	16	Negative	< LOD
229	Wall	Gypsum	C	Intact	Ivory	Mechanical	16	Negative	< LOD
230	Wall	Gypsum	B	Intact	Ivory	Mechanical	16	Negative	< LOD
231	Wall	Gypsum	A	Intact	Ivory	Mechanical	16	Negative	< LOD
232	Ceiling	Gypsum		Intact	Ivory	Mechanical	16	Negative	< LOD
233	Shelf	Wood	B	Intact	Ivory	Mechanical	16	Negative	< LOD
234	Door	Wood	A	Intact	Ivory	Mechanical	16	Negative	< LOD
235	Door Casing	Wood	A	Intact	Ivory	Mechanical	16	Negative	< LOD
236	Wall	Gypsum	D	Intact	Ivory	Bathroom	16	Negative	< LOD
237	Wall	Gypsum	C	Intact	Ivory	Bathroom	16	Negative	< LOD
238	Wall	Gypsum	B	Intact	Ivory	Bathroom	16	Negative	< LOD
239	Wall	Gypsum	A	Intact	Ivory	Bathroom	16	Negative	< LOD
240	Ceiling	Gypsum		Intact	Ivory	Bathroom	16	Negative	< LOD
241	Chair Rail	Wood	B	Intact	Ivory	Bathroom	16	Negative	< LOD
242	Door Jamb	Wood	A	Intact	Varnish	Bathroom	16	Negative	< LOD
243	Door	Wood	A	Intact	Varnish	Bathroom	16	Negative	< LOD
244	Shelf	Wood	A	Intact	Ivory	Bathroom	16	Negative	< LOD
245	Wall	Gypsum	A	Intact	Ivory	Bedroom	16	Negative	< LOD
246	Wall	Gypsum	B	Intact	Ivory	Bedroom	16	Negative	< LOD
247	Wall	Gypsum	C	Intact	Ivory	Bedroom	16	Negative	< LOD

LOD = LIMIT OF DETECTION



PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading #	Component	Substrate	Side	Condition	Color	Room	Unit #	Results	PbC
248	Wall	Gypsum	D	Intact	Ivory	Bedroom	16	Negative	< LOD
249	Ceiling	Gypsum		Intact	Ivory	Bedroom	16	Negative	< LOD
250	Window Casing	Wood	C	Intact	Brown	Bedroom	16	Negative	< LOD
251	Window Sash	Vinyl	C	Intact	White	Bedroom	16	Negative	< LOD
252	Shelf	Wood	D	Intact	Ivory	Bedroom	16	Negative	< LOD
253	Door	Metal	D	Intact	White	Bedroom	16	Negative	< LOD
254	Door Casing	Wood	D	Intact	Varnish	Bedroom	16	Negative	< LOD
255	Door Stop	Wood	A	Intact	Varnish	Bedroom	16	Negative	< LOD
256	Door	Wood	A	Intact	Varnish	Bedroom	16	Negative	< LOD
257	Wall	Gypsum	A	Intact	Ivory	Bedroom	16	Negative	< LOD
258	Wall	Gypsum	B	Intact	Ivory	Bedroom	16	Negative	< LOD
259	Wall	Gypsum	C	Intact	Ivory	Bedroom	16	Negative	< LOD
260	Wall	Gypsum	D	Intact	Ivory	Bedroom	16	Negative	< LOD
261	Ceiling	Gypsum		Intact	Ivory	Bedroom	16	Negative	< LOD
262	Door	Metal	D	Intact	White	Bedroom	16	Negative	< LOD
263	Door Casing	Wood	D	Intact	Ivory	Bedroom	16	Negative	< LOD
264	Shelf	Wood	D	Intact	Ivory	Bedroom	16	Negative	< LOD
265	Door Stop	Wood	D	Intact	Varnish	Bedroom	16	Negative	< LOD
266	Door	Wood	D	Intact	Varnish	Bedroom	16	Negative	< LOD
267	Wall	Gypsum	A	Intact	Ivory	Bedroom	16	Negative	< LOD
268	Wall	Gypsum	B	Intact	Ivory	Bedroom	16	Negative	< LOD
269	Wall	Gypsum	C	Intact	Ivory	Bedroom	16	Negative	< LOD
270	Wall	Gypsum	D	Intact	Ivory	Bedroom	16	Negative	< LOD
271	Ceiling	Gypsum		Intact	Ivory	Bedroom	16	Negative	< LOD
272	Window Casing	Wood	A	Intact	Ivory	Bedroom	16	Negative	< LOD
273	Window Sash	Vinyl	A	Intact	Ivory	Bedroom	16	Negative	< LOD
274	Door Jamb	Wood	C	Intact	Ivory	Bedroom	16	Negative	< LOD
275	Door	Wood	C	Intact	Ivory	Bedroom	16	Negative	< LOD
276	Door	Metal	D	Intact	Ivory	Bedroom	16	Negative	< LOD
277	Shelf	Wood	D	Intact	Ivory	Bedroom	16	Negative	< LOD
278	Door Casing	Wood	D	Intact	Ivory	Bedroom	16	Negative	< LOD
279	Wall	Gypsum	A	Intact	Ivory	Living Room	17	Negative	< LOD
280	Wall	Gypsum	B	Intact	Ivory	Living Room	17	Negative	< LOD
281	Wall	Gypsum	C	Intact	Ivory	Living Room	17	Negative	< LOD
282	Wall	Gypsum	D	Intact	Ivory	Living Room	17	Negative	< LOD
283	Ceiling	Gypsum		Intact	Ivory	Living Room	17	Negative	< LOD
284	Door Casing	Wood	A	Intact	Ivory	Living Room	17	Negative	< LOD
285	Door	Metal	A	Intact	Ivory	Living Room	17	Negative	< LOD
286	Stringer	Wood	B	Intact	Ivory	Living Room	17	Negative	< LOD
287	Rail	Wood	B	Intact	Varnish	Living Room	17	Negative	< LOD
288	Window Casing	Wood	A	Intact	Ivory	Living Room	17	Negative	< LOD

LOD = LIMIT OF DETECTION

PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading #	Component	Substrate	Side	Condition	Color	Room	Unit #	Results	PbC
289	Window Sash	Metal	A	Intact	White	Living Room	17	Negative	< LOD
290	Wall	Gypsum	D	Intact	Ivory	Kitchen	17	Negative	< LOD
291	Wall	Gypsum	C	Intact	Ivory	Kitchen	17	Negative	< LOD
292	Wall	Gypsum	B	Intact	Ivory	Kitchen	17	Negative	< LOD
293	Wall	Gypsum	A	Intact	Ivory	Kitchen	17	Negative	< LOD
294	Ceiling	Gypsum		Intact	Ivory	Kitchen	17	Negative	< LOD
295	Window Sill	Wood	D	Intact	Ivory	Kitchen	17	Negative	< LOD
296	Window Sash	Vinyl	D	Intact	White	Kitchen	17	Negative	< LOD
297	Door Casing	Wood	C	Intact	Ivory	Kitchen	17	Negative	< LOD
298	Door	Metal	C	Intact	White	Kitchen	17	Negative	< LOD
299	Drawer	Wood	B	Intact	Varnish	Kitchen	17	Negative	< LOD
300	Cabinet	Wood	B	Intact	Varnish	Kitchen	17	Negative	< LOD
301	Wall	Gypsum	B	Intact	Ivory	Mechanical	17	Negative	< LOD
302	Wall	Gypsum	C	Intact	Ivory	Mechanical	17	Negative	< LOD
303	Wall	Gypsum	D	Intact	Ivory	Mechanical	17	Negative	< LOD
304	Wall	Gypsum	A	Intact	Ivory	Mechanical	17	Negative	< LOD
305	Ceiling	Gypsum		Intact	Ivory	Mechanical	17	Negative	< LOD
306	Shelf	Wood	D	Intact	Ivory	Mechanical	17	Negative	< LOD
307	Door Jamb	Wood	D	Intact	Ivory	Mechanical	17	Negative	< LOD
308	Door Casing	Wood	D	Intact	Ivory	Mechanical	17	Negative	< LOD
309	Wall	Gypsum	D	Intact	Ivory	Bathroom	17	Negative	< LOD
310	Wall	Gypsum	C	Intact	Ivory	Bathroom	17	Negative	< LOD
311	Wall	Gypsum	B	Intact	Ivory	Bathroom	17	Negative	< LOD
312	Wall	Gypsum	A	Intact	Ivory	Bathroom	17	Negative	< LOD
313	Ceiling	Gypsum		Intact	Ivory	Bathroom	17	Negative	< LOD
314	Chair Rail	Wood	B	Intact	Ivory	Bathroom	17	Negative	< LOD
315	Door Stop	Wood	A	Intact	Ivory	Bathroom	17	Negative	< LOD
316	Door	Wood	A	Intact	Varnish	Bathroom	17	Negative	< LOD
317	Shelf	Wood	B	Intact	Ivory	Bathroom	17	Negative	< LOD
318	Door Stop	Wood	B	Intact	Ivory	Bathroom	17	Negative	< LOD
319	Door	Wood	B	Intact	Varnish	Bathroom	17	Negative	< LOD
320	Wall	Gypsum	A	Intact	Ivory	Bedroom	17	Negative	< LOD
321	Wall	Gypsum	B	Intact	Ivory	Bedroom	17	Negative	< LOD
322	Wall	Gypsum	C	Intact	Ivory	Bedroom	17	Negative	< LOD
323	Wall	Gypsum	D	Intact	Ivory	Bedroom	17	Negative	< LOD
324	Ceiling	Gypsum		Intact	Ivory	Bedroom	17	Negative	< LOD
325	Window Casing	Wood	C	Intact	Ivory	Bedroom	17	Negative	< LOD
326	Window Sash	Vinyl	C	Intact	Ivory	Bedroom	17	Negative	< LOD
327	Door Casing	Wood	B	Intact	Ivory	Bedroom	17	Negative	< LOD
328	Door	Metal	B	Intact	Ivory	Bedroom	17	Negative	< LOD
329	Shelf	Wood	B	Intact	Ivory	Bedroom	17	Negative	< LOD

LOD = LIMIT OF DETECTION

PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading #	Component	Substrate	Side	Condition	Color	Room	Unit #	Results	PbC
330	Door Stop	Wood	A	Intact	Ivory	Bedroom	17	Negative	< LOD
331	Door	Wood	A	Intact	Varnish	Bedroom	17	Negative	< LOD
332	Door Stop	Wood	B	Intact	Ivory	Bedroom	17	Negative	< LOD
333	Door	Wood	B	Intact	Varnish	Bedroom	17	Negative	< LOD
334	Wall	Gypsum	C	Intact	Ivory	Bedroom	17	Negative	< LOD
335	Wall	Gypsum	D	Intact	Ivory	Bedroom	17	Negative	< LOD
336	Wall	Gypsum	B	Intact	Ivory	Bedroom	17	Negative	< LOD
337	Wall	Gypsum	A	Intact	Ivory	Bedroom	17	Negative	< LOD
338	Window Casing	Wood	D	Intact	Ivory	Bedroom	17	Negative	< LOD
339	Window Sash	Vinyl	D	Intact	White	Bedroom	17	Negative	< LOD
340	Door Stop	Wood	B	Intact	Ivory	Bedroom	17	Negative	< LOD
341	Door	Metal	B	Intact	White	Bedroom	17	Negative	< LOD
342	Shelf	Wood	B	Intact	Ivory	Bedroom	17	Negative	< LOD
343	Shelf	Wood	B	Intact	Ivory	Bedroom	17	Negative	< LOD
344	Door Stop	Wood	B	Intact	Ivory	Bedroom	17	Negative	< LOD
345	Door	Wood	B	Intact	Varnish	Bedroom	17	Negative	< LOD
346	Wall	Gypsum	A	Intact	Ivory	Bedroom	17	Negative	< LOD
347	Wall	Gypsum	B	Intact	Ivory	Bedroom	17	Negative	< LOD
348	Wall	Gypsum	C	Intact	Ivory	Bedroom	17	Negative	< LOD
349	Wall	Gypsum	D	Intact	Ivory	Bedroom	17	Negative	< LOD
350	Ceiling	Gypsum		Intact	White	Bedroom	17	Negative	< LOD
351	Window Casing	Wood	A	Intact	Ivory	Bedroom	17	Negative	< LOD
352	Window Sash	Vinyl	A	Intact	White	Bedroom	17	Negative	< LOD
353	Door Casing	Wood	B	Intact	Ivory	Bedroom	17	Negative	< LOD
354	Door	Metal	B	Intact	White	Bedroom	17	Negative	< LOD
355	Shelf	Metal	B	Intact	Ivory	Bedroom	17	Negative	< LOD
356	Trim	Metal	A	Intact	White	Exterior	G-3	Negative	< LOD
357	Down Spout	Metal	A	Intact	White	Exterior	G-3	Negative	< LOD
358	Fascia	Metal	A	Intact	White	Exterior	G-3	Negative	< LOD
359	Soffit	Metal	A	Intact	White	Exterior	G-3	Positive	1
360	Wall	Gypsum	A	Intact	Ivory	Living Room	18	Negative	< LOD
361	Wall	Gypsum	B	Intact	Ivory	Living Room	18	Negative	< LOD
362	Wall	Gypsum	C	Intact	Ivory	Living Room	18	Negative	< LOD
363	Wall	Gypsum	D	Intact	Ivory	Living Room	18	Negative	< LOD
364	Ceiling	Gypsum		Intact	Ivory	Living Room	18	Negative	< LOD
365	Stringer	Wood	B	Intact	Ivory	Living Room	18	Negative	< LOD
366	Base	Wood	B	Intact	Ivory	Living Room	18	Negative	< LOD
367	Door Jamb	Metal	A	Intact	Ivory	Living Room	18	Negative	< LOD
368	Door	Metal	A	Intact	Ivory	Living Room	18	Negative	< LOD
369	Window Sill	Wood	A	Intact	Ivory	Living Room	18	Negative	< LOD
370	Window Sash	Vinyl	A	Intact	Ivory	Living Room	18	Negative	< LOD

LOD = LIMIT OF DETECTION

PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading #	Component	Substrate	Side	Condition	Color	Room	Unit #	Results	PbC
371	Wall	Gypsum	D	Intact	Ivory	Kitchen	18	Negative	< LOD
372	Wall	Gypsum	C	Intact	Ivory	Kitchen	18	Negative	< LOD
373	Wall	Gypsum	B	Intact	Ivory	Kitchen	18	Negative	< LOD
374	Wall	Gypsum	A	Intact	Ivory	Kitchen	18	Negative	< LOD
375	Ceiling	Gypsum		Intact	Ivory	Kitchen	18	Negative	< LOD
376	Drawer	Wood	D	Intact	Varnish	Kitchen	18	Negative	< LOD
377	Cabinet	Wood	D	Intact	Varnish	Kitchen	18	Negative	< LOD
378	Door Jamb	Wood	C	Intact	Ivory	Kitchen	18	Negative	< LOD
379	Window Casing	Wood	C	Intact	Ivory	Kitchen	18	Negative	< LOD
380	Window Sash	Vinyl	C	Intact	White	Kitchen	18	Negative	< LOD
381	Wall	Gypsum	B	Intact	Ivory	Mechanical	18	Negative	< LOD
382	Wall	Gypsum	C	Intact	Ivory	Mechanical	18	Negative	< LOD
383	Wall	Gypsum	D	Intact	Ivory	Mechanical	18	Negative	< LOD
384	Wall	Gypsum	A	Intact	Ivory	Mechanical	18	Negative	< LOD
385	Ceiling	Gypsum		Intact	Ivory	Mechanical	18	Negative	< LOD
386	Shelf	Wood	D	Intact	Ivory	Mechanical	18	Negative	< LOD
387	Window Sill	Wood	B	Intact	White	Mechanical	18	Negative	< LOD
388	Window Sash	Vinyl	B	Intact	Ivory	Mechanical	18	Negative	< LOD
389	Base	Wood	A	Intact	Ivory	Mechanical	18	Negative	< LOD
390	Wall	Gypsum	A	Intact	Ivory	Bathroom	18	Negative	< LOD
391	Wall	Gypsum	B	Intact	Ivory	Bathroom	18	Negative	< LOD
392	Wall	Gypsum	C	Intact	Ivory	Bathroom	18	Negative	< LOD
393	Wall	Gypsum	D	Intact	Ivory	Bathroom	18	Negative	< LOD
394	Ceiling	Gypsum		Intact	Ivory	Bathroom	18	Negative	< LOD
395	Chair Rail	Wood	A	Intact	Ivory	Bathroom	18	Negative	< LOD
396	Door Stop	Wood	D	Intact	Ivory	Bathroom	18	Negative	< LOD
397	Door	Wood	D	Intact	Varnish	Bathroom	18	Negative	< LOD
398	Door	Wood	C	Intact	Ivory	Living Room	18	Negative	< LOD
399	Door Casing	Wood	C	Intact	Ivory	Living Room	18	Negative	< LOD
400	Shelf	Wood	C	Intact	Ivory	Living Room	18	Negative	< LOD
401	Wall	Gypsum	A	Intact	Ivory	Bedroom	18	Negative	< LOD
402	Wall	Gypsum	B	Intact	Ivory	Bedroom	18	Negative	< LOD
403	Wall	Gypsum	C	Intact	Ivory	Bedroom	18	Negative	< LOD
404	Wall	Gypsum	D	Intact	Ivory	Bedroom	18	Negative	< LOD
405	Ceiling	Gypsum		Intact	Ivory	Bedroom	18	Negative	< LOD
406	Window Casing	Wood	D	Intact	Ivory	Bedroom	18	Negative	< LOD
407	Window Sash	Vinyl	D	Intact	White	Bedroom	18	Negative	< LOD
408	Door Stop	Wood	B	Intact	Ivory	Bedroom	18	Negative	< LOD
409	Door	Wood	B	Intact	Varnish	Bedroom	18	Negative	< LOD
410	Wall	Gypsum	A	Intact	Ivory	Bathroom	18	Negative	< LOD
411	Wall	Gypsum	B	Intact	Ivory	Bathroom	18	Negative	< LOD

LOD = LIMIT OF DETECTION



PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading #	Component	Substrate	Side	Condition	Color	Room	Unit #	Results	PbC
412	Wall	Gypsum	C	Intact	Ivory	Bathroom	18	Negative	< LOD
413	Wall	Gypsum	D	Intact	Ivory	Bathroom	18	Negative	< LOD
414	Ceiling	Gypsum		Intact	Ivory	Bathroom	18	Negative	< LOD
415	Chair Rail	Wood	D	Intact	Ivory	Bathroom	18	Negative	< LOD
416	Window Casing	Wood	B	Intact	Ivory	Bathroom	18	Negative	< LOD
417	Window Sash	Vinyl	B	Intact	Ivory	Bathroom	18	Negative	< LOD
418	Door Jamb	Wood	B	Intact	Ivory	Bathroom	18	Negative	< LOD
419	Wall	Gypsum	D	Intact	Ivory	Bedroom	18	Negative	< LOD
420	Wall	Gypsum	A	Intact	Ivory	Bedroom	18	Negative	< LOD
421	Wall	Gypsum	B	Intact	Ivory	Bedroom	18	Negative	< LOD
422	Wall	Gypsum	C	Intact	Ivory	Bedroom	18	Negative	< LOD
423	Ceiling	Gypsum		Intact	Ivory	Bedroom	18	Negative	< LOD
424	Door Casing	Wood	D	Intact	Ivory	Bedroom	18	Negative	< LOD
425	Door	Wood	D	Intact	Ivory	Bedroom	18	Negative	< LOD
426	Shelf	Wood	A	Intact	Ivory	Bedroom	18	Negative	< LOD
427	Window Sill	Wood	A	Intact	Ivory	Bedroom	18	Negative	< LOD
428	Window Sash	Vinyl	A	Intact	White	Bedroom	18	Negative	< LOD
429	Door Stop	Wood	C	Intact	Ivory	Bedroom	18	Negative	< LOD
430	Door	Wood	C	Intact	Ivory	Bedroom	18	Negative	< LOD
431	Wall	Gypsum	A	Intact	Ivory	Bedroom	18	Negative	< LOD
432	Wall	Gypsum	B	Intact	Ivory	Bedroom	18	Negative	< LOD
433	Wall	Gypsum	C	Intact	Ivory	Bedroom	18	Negative	< LOD
434	Wall	Gypsum	D	Intact	Ivory	Bedroom	18	Negative	< LOD
435	Ceiling	Gypsum		Intact	Ivory	Bedroom	18	Negative	< LOD
436	Window Sill	Wood	D	Intact	Ivory	Bedroom	18	Negative	< LOD
437	Window Sash	Wood	D	Intact	Ivory	Bedroom	18	Negative	< LOD
438	Shelf	Wood	A	Intact	Ivory	Bedroom	18	Negative	< LOD
439	Door Casing	Wood	A	Intact	Ivory	Bedroom	18	Negative	< LOD
440	Wall	Gypsum	B	Intact	Ivory	Bedroom	18	Negative	< LOD
441	Wall	Gypsum	C	Intact	Ivory	Bedroom	18	Negative	< LOD
442	Wall	Gypsum	D	Intact	Ivory	Bedroom	18	Negative	< LOD
443	Wall	Gypsum	A	Intact	Ivory	Bedroom	18	Negative	< LOD
444	Ceiling	Gypsum		Intact	Ivory	Bedroom	18	Negative	< LOD
445	Window Sill	Wood	A	Intact	Ivory	Bedroom	18	Negative	< LOD
446	Window Sash	Vinyl	A	Intact	Ivory	Bedroom	18	Negative	< LOD
447	Shelf	Wood	B	Intact	Ivory	Bedroom	18	Negative	< LOD
448	Door	Wood	B	Intact	Ivory	Bedroom	18	Negative	< LOD
449	Door Casing	Wood	B	Intact	Ivory	Bedroom	18	Negative	< LOD
450	Wall	Gypsum	A	Intact	Ivory	Living Room	19	Negative	< LOD
451	Wall	Gypsum	B	Intact	Ivory	Living Room	19	Negative	< LOD
452	Wall	Gypsum	C	Intact	Ivory	Living Room	19	Negative	< LOD

LOD = LIMIT OF DETECTION



PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading #	Component	Substrate	Side	Condition	Color	Room	Unit #	Results	PbC
453	Wall	Gypsum	D	Intact	Ivory	Living Room	19	Negative	< LOD
454	Ceiling	Gypsum		Intact	Ivory	Living Room	19	Negative	< LOD
455	Parting Bead	Wood	D	Intact	Ivory	Living Room	19	Negative	< LOD
456	Window Sash	Vinyl	D	Intact	White	Living Room	19	Negative	< LOD
457	Door Casing	Wood	D	Intact	Ivory	Living Room	19	Negative	< LOD
458	Door	Metal	D	Intact	White	Living Room	19	Negative	< LOD
459	Stringer	Wood	C	Intact	Ivory	Living Room	19	Negative	< LOD
460	Rail	Wood	C	Intact	Varnish	Living Room	19	Negative	< LOD
461	Shelf	Wood	C	Intact	Ivory	Living Room	19	Negative	< LOD
462	Door	Wood	C	Intact	White	Living Room	19	Negative	< LOD
463	Door Casing	Wood	C	Intact	Ivory	Living Room	19	Negative	< LOD
464	Wall	Gypsum	D	Intact	Ivory	Kitchen	19	Negative	< LOD
465	Wall	Gypsum	C	Intact	Ivory	Kitchen	19	Negative	< LOD
466	Wall	Gypsum	B	Intact	Ivory	Kitchen	19	Negative	< LOD
467	Wall	Gypsum	A	Intact	Ivory	Kitchen	19	Negative	< LOD
468	Ceiling	Gypsum		Intact	Ivory	Kitchen	19	Negative	< LOD
469	Window Sill	Wood	D	Intact	Ivory	Kitchen	19	Negative	< LOD
470	Window Sash	Vinyl	D	Intact	White	Kitchen	19	Negative	< LOD
471	Door Casing	Wood	C	Intact	Ivory	Kitchen	19	Negative	< LOD
472	Door	Metal	C	Intact	White	Kitchen	19	Negative	< LOD
473	Drawer	Wood	B	Intact	Varnish	Kitchen	19	Negative	< LOD
474	Cabinet	Wood	B	Intact	Varnish	Kitchen	19	Negative	< LOD
475	Door Jamb	Wood	D	Intact	Ivory	Kitchen	19	Negative	< LOD
476	Wall	Gypsum	A	Intact	Ivory	Mechanical	19	Negative	< LOD
477	Wall	Gypsum	B	Intact	Ivory	Mechanical	19	Negative	< LOD
478	Wall	Gypsum	C	Intact	Ivory	Mechanical	19	Negative	< LOD
479	Wall	Gypsum	D	Intact	Ivory	Mechanical	19	Negative	< LOD
480	Ceiling	Gypsum		Intact	Ivory	Mechanical	19	Negative	< LOD
481	Shelf	Wood	B	Intact	Ivory	Mechanical	19	Negative	< LOD
482	Base	Wood	D	Intact	Ivory	Mechanical	19	Negative	< LOD
483	Wall	Gypsum	B	Intact	Ivory	Bathroom	19	Negative	< LOD
484	Wall	Gypsum	C	Intact	Ivory	Bathroom	19	Negative	< LOD
485	Wall	Gypsum	D	Intact	Ivory	Bathroom	19	Negative	< LOD
486	Wall	Gypsum	A	Intact	Ivory	Bathroom	19	Negative	0.22
487	Ceiling	Gypsum		Intact	Ivory	Bathroom	19	Negative	< LOD
488	Chair Rail	Wood	C	Intact	Ivory	Bathroom	19	Negative	< LOD
489	Door	Wood	A	Intact	Ivory	Bathroom	19	Negative	< LOD
490	Door Jamb	Wood	A	Intact	Ivory	Bathroom	19	Negative	< LOD
491	Wall	Gypsum	D	Intact	Ivory	Bedroom	19	Negative	< LOD
492	Wall	Gypsum	A	Intact	Ivory	Bedroom	19	Negative	< LOD
493	Wall	Gypsum	B	Intact	Ivory	Bedroom	19	Negative	< LOD

LOD = LIMIT OF DETECTION

PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading #	Component	Substrate	Side	Condition	Color	Room	Unit #	Results	PbC
494	Wall	Gypsum	C	Intact	Ivory	Bedroom	19	Negative	< LOD
495	Ceiling	Gypsum		Intact	Ivory	Bedroom	19	Negative	< LOD
496	Window Sill	Wood	A	Intact	Ivory	Bedroom	19	Negative	< LOD
497	Window Sash	Vinyl	A	Intact	Ivory	Bedroom	19	Negative	< LOD
498	Door Jamb	Wood	C	Intact	Ivory	Bedroom	19	Negative	< LOD
499	Door	Wood	C	Intact	Ivory	Bedroom	19	Negative	< LOD
500	Wall	Gypsum	D	Intact	Ivory	Bathroom	19	Negative	0.21
501	Wall	Gypsum	C	Intact	Ivory	Bathroom	19	Negative	< LOD
502	Wall	Gypsum	B	Intact	Ivory	Bathroom	19	Negative	< LOD
503	Wall	Gypsum	A	Intact	Ivory	Bathroom	19	Negative	< LOD
504	Ceiling	Gypsum		Intact	Ivory	Bathroom	19	Negative	< LOD
505	Window Casing	Wood	C	Intact	Ivory	Bathroom	19	Negative	< LOD
506	Window Sash	Vinyl	C	Intact	White	Bathroom	19	Negative	< LOD
507	Door Stop	Wood	B	Intact	Ivory	Bathroom	19	Negative	< LOD
508	Door Casing	Wood	A	Intact	Ivory	Bathroom	19	Negative	< LOD
509	Door	Metal	A	Intact	Ivory	Bathroom	19	Negative	< LOD
510	Wall	Gypsum	B	Intact	Ivory	Bedroom	19	Negative	< LOD
511	Wall	Gypsum	A	Intact	Ivory	Bedroom	19	Negative	< LOD
512	Wall	Gypsum	D	Intact	Ivory	Bedroom	19	Negative	< LOD
513	Wall	Gypsum	C	Intact	Ivory	Bedroom	19	Negative	< LOD
514	Ceiling	Gypsum		Intact	Ivory	Bedroom	19	Negative	< LOD
515	Window Sill	Wood	D	Intact	Ivory	Bedroom	19	Negative	< LOD
516	Window Sash	Vinyl	D	Intact	White	Bedroom	19	Negative	< LOD
517	Door	Wood	A	Intact	Ivory	Bedroom	19	Negative	< LOD
518	Door Jamb	Wood	A	Intact	Ivory	Bedroom	19	Negative	< LOD
519	Shelf	Wood	A	Intact	Ivory	Bedroom	19	Negative	< LOD
520	Wall	Gypsum	C	Intact	Ivory	Bedroom	19	Negative	< LOD
521	Wall	Gypsum	D	Intact	Ivory	Bedroom	19	Negative	< LOD
522	Wall	Gypsum	A	Intact	Ivory	Bedroom	19	Negative	< LOD
523	Wall	Gypsum	B	Intact	Ivory	Bedroom	19	Negative	< LOD
524	Ceiling	Gypsum		Intact	Ivory	Bedroom	19	Negative	< LOD
525	Parting Bead	Wood	A	Intact	Ivory	Bedroom	19	Negative	< LOD
526	Window Sash	Vinyl	A	Intact	Ivory	Bedroom	19	Negative	< LOD
527	Shelf	Wood	D	Intact	Ivory	Bedroom	19	Negative	< LOD
528	Door Casing	Wood	D	Intact	Ivory	Bedroom	19	Negative	< LOD
529	Door	Wood	D	Intact	Ivory	Bedroom	19	Negative	< LOD
530	Door Jamb	Wood	C	Intact	Ivory	Bedroom	19	Negative	< LOD
531	Door	Wood	C	Intact	Ivory	Bedroom	19	Negative	< LOD
532	Wall	Gypsum	B	Intact	Ivory	Bedroom	19	Negative	< LOD
533	Wall	Gypsum	C	Intact	Ivory	Bedroom	19	Negative	< LOD
534	Wall	Gypsum	D	Intact	Ivory	Bedroom	19	Negative	< LOD

LOD = LIMIT OF DETECTION

PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading #	Component	Substrate	Side	Condition	Color	Room	Unit #	Results	PbC
535	Wall	Gypsum	A	Intact	Ivory	Bedroom	19	Negative	< LOD
536	Ceiling	Gypsum		Intact	Ivory	Bedroom	19	Negative	< LOD
537	Shelf	Wood	C	Intact	Ivory	Bedroom	19	Negative	< LOD
538	Window Sill	Wood	D	Intact	Ivory	Bedroom	19	Negative	< LOD
539	Window Sash	Vinyl	D	Intact	Ivory	Bedroom	19	Negative	< LOD
540	Door Casing	Wood	B	Intact	Ivory	Bedroom	19	Negative	< LOD
541	Door	Metal	B	Intact	Ivory	Bedroom	19	Negative	< LOD
<b>542</b>	<b>Window Trim</b>	<b>Metal</b>	<b>D</b>	<b>Intact</b>	<b>White</b>	<b>Exterior</b>	<b>H-1</b>	<b>Positive</b>	<b>2.5</b>
<b>543</b>	<b>Window Trim</b>	<b>Metal</b>	<b>B</b>	<b>Intact</b>	<b>White</b>	<b>Exterior</b>	<b>H-1</b>	<b>Positive</b>	<b>1.3</b>
544	Window Trim	Metal	B	Intact	White	Exterior	H-1	Negative	< LOD
545	Fascia	Metal	B	Intact	White	Exterior	H-1	Negative	< LOD
546	Soffit	Metal	B	Intact	White	Exterior	H-1	Negative	< LOD
547	Down Spout	Metal	A	Intact	White	Exterior	H-1	Negative	< LOD
<b>548</b>	<b>Window Trim</b>	<b>Metal</b>	<b>A</b>	<b>Intact</b>	<b>White</b>	<b>Exterior</b>	<b>H-1</b>	<b>Positive</b>	<b>1.2</b>
549	Window Trim	Metal	A	Intact	White	Exterior	H-1	Negative	< LOD
<b>550</b>	<b>Window Trim</b>	<b>Metal</b>	<b>A</b>	<b>Intact</b>	<b>White</b>	<b>Exterior</b>	<b>H-1</b>	<b>Positive</b>	<b>1.9</b>
551	Window Trim	Metal	D	Intact	White	Exterior	H-1	Negative	< LOD
<b>552</b>	<b>Window Trim</b>	<b>Metal</b>	<b>D</b>	<b>Intact</b>	<b>White</b>	<b>Exterior</b>	<b>H-1</b>	<b>Positive</b>	<b>2.1</b>
553	Wall	Gypsum	C	Intact	Ivory	Living Room	7	Negative	< LOD
554	Wall	Gypsum	D	Intact	Ivory	Living Room	7	Negative	< LOD
555	Wall	Gypsum	A	Intact	Ivory	Living Room	7	Negative	< LOD
556	Wall	Gypsum	B	Intact	Ivory	Living Room	7	Negative	< LOD
557	Ceiling	Gypsum		Intact	Ivory	Living Room	7	Negative	< LOD
558	Window Sill	Wood	C	Intact	Ivory	Living Room	7	Negative	< LOD
559	Window Sash	Vinyl	C	Intact	White	Living Room	7	Negative	< LOD
560	Door Jamb	Metal	C	Intact	Ivory	Living Room	7	Negative	< LOD
561	Door	Metal	C	Intact	Ivory	Living Room	7	Negative	< LOD
562	Base	Wood	D	Intact	Ivory	Living Room	7	Negative	< LOD
563	Wall	Gypsum	D	Intact	Ivory	Kitchen	7	Negative	< LOD
564	Wall	Gypsum	A	Intact	Ivory	Kitchen	7	Negative	< LOD
565	Wall	Gypsum	B	Intact	Ivory	Kitchen	7	Negative	< LOD
566	Wall	Gypsum	C	Intact	Ivory	Kitchen	7	Negative	< LOD
567	Wall	Gypsum	D	Intact	Ivory	Kitchen	7	Negative	< LOD
568	Ceiling	Gypsum		Intact	Ivory	Kitchen	7	Negative	< LOD
569	Window Sill	Wood		Intact	Ivory	Kitchen	7	Negative	< LOD
570	Window Sash	Vinyl		Intact	White	Kitchen	7	Negative	< LOD
571	Drawer	Wood		Intact	Varnish	Kitchen	7	Negative	< LOD
572	Cabinet	Wood		Intact	Varnish	Kitchen	7	Negative	< LOD
573	Wall	Gypsum	A	Intact	Ivory	Mechanical	7	Negative	< LOD
574	Wall	Gypsum	B	Intact	Ivory	Mechanical	7	Negative	< LOD
575	Wall	Gypsum	C	Intact	Ivory	Mechanical	7	Negative	< LOD

LOD = LIMIT OF DETECTION



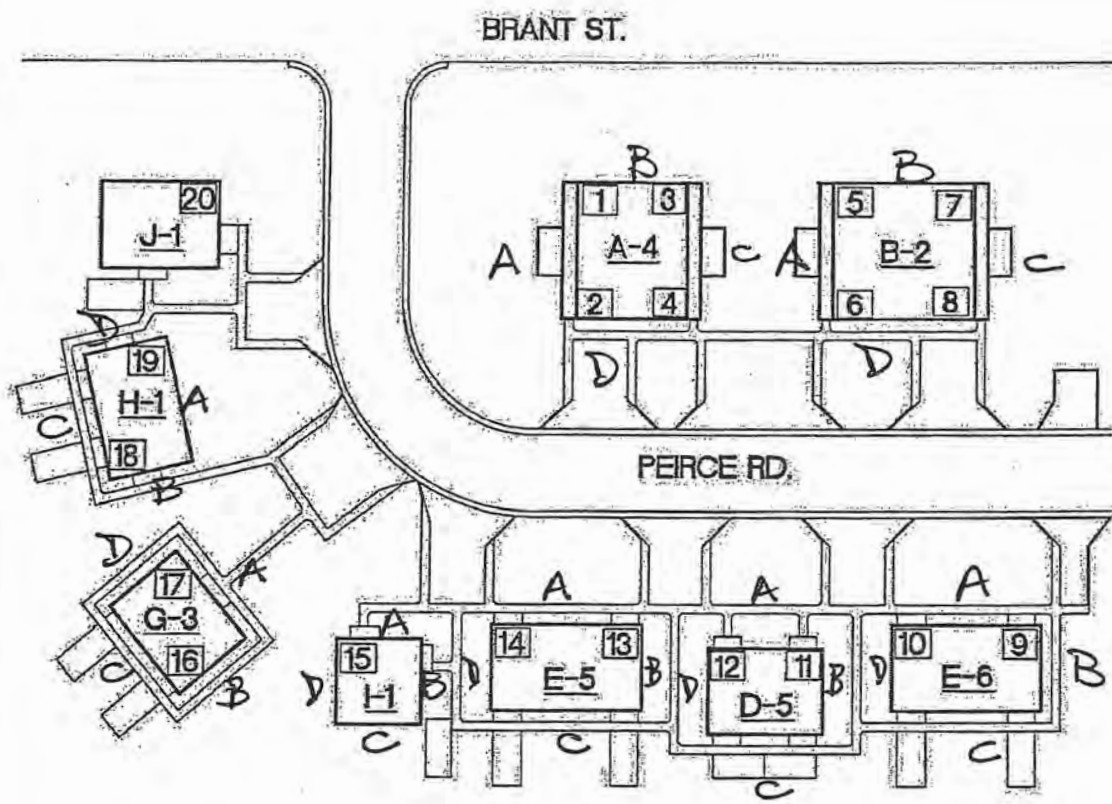
PIKE COUNTY HOUSING AUTHORITY  
PLEASANT HILL

Reading #	Component	Substrate	Side	Condition	Color	Room	Unit #	Results	PbC
576	Wall	Gypsum	D	Intact	Ivory	Mechanical	7	Negative	< LOD
577	Ceiling	Gypsum		Intact	Ivory	Mechanical	7	Negative	< LOD
578	Door Stop	Wood	D	Intact	Ivory	Mechanical	7	Negative	< LOD
579	Door	Wood	D	Intact	Ivory	Mechanical	7	Negative	< LOD
580	Shelf	Wood	C	Intact	Ivory	Mechanical	7	Negative	< LOD
581	Wall	Gypsum	D	Intact	Ivory	Bedroom	7	Negative	< LOD
582	Wall	Gypsum	A	Intact	Ivory	Bedroom	7	Negative	< LOD
584	Wall	Gypsum	B	Intact	Ivory	Bedroom	7	Negative	< LOD
585	Wall	Gypsum	C	Intact	Ivory	Bedroom	7	Negative	< LOD
586	Ceiling	Gypsum		Intact	Ivory	Bedroom	7	Negative	< LOD
587	Door Stop	Wood	C	Intact	Ivory	Bedroom	7	Negative	< LOD
588	Door	Wood	C	Intact	Ivory	Bedroom	7	Negative	< LOD
589	Shelf	Wood	D	Intact	Ivory	Bedroom	7	Negative	< LOD
590	Wall	Gypsum	C	Intact	Ivory	Bathroom	7	Negative	0.16
591	Wall	Gypsum	D	Intact	Ivory	Bathroom	7	Negative	< LOD
592	Wall	Gypsum	A	Intact	Ivory	Bathroom	7	Negative	< LOD
593	Wall	Gypsum	B	Intact	Ivory	Bathroom	7	Negative	< LOD
594	Ceiling	Gypsum		Intact	Ivory	Bathroom	7	Negative	< LOD
595	Chair Rail	Wood		Intact	Ivory	Bathroom	7	Negative	< LOD
596	Door Jamb	Wood		Intact	Ivory	Bathroom	7	Negative	< LOD
597	Door	Wood		Intact	Varnish	Bathroom	7	Negative	< LOD
598	Calibrate								1
599	Calibrate								1
600	Calibrate								1.1
601	Calibrate								0.9

LOD = LIMIT OF DETECTION



# **SECTION 4**




# KEY SITE PLAN

NO SCALE

IL-71-3/PLEASANT HILL



*17-115*

Project No.: 1059	Project Title: KEY SITE PLANS	 <b>EGGEMEYER ASSOCIATES ARCHITECTS</b> Westtown Centre P.O. Box 1447 Carbondale, IL 62903 IDPR 184-000255 T 618.549.3361 F 618.549.3363 eggemeyer-architects.com	Sheet:
Date: AUG 2011	Projects: IL-71-1, IL-71-2, IL-71-3, IL-71-4, IL-71-5, IL-71-6, IL-71-9, IL-71-10, IL-71-13, IL-71-14 & IL-71-15 For The: PIKE COUNTY HOUSING AUTHORITY		<b>C-4</b>
Checked: MBD			

# **SECTION 5**



**LEAD RISK  
ASSESSOR LICENSE**

LEAD ID	ISSUED	EXPIRES
001417	1/31/2013	1/31/2014

Darrin Hinds  
2975 Stanton St  
Springfield, IL 62703



ILLINOIS LEAD PROGRAM  
Environmental Health

Alteration of this license shall result in legal action  
**RISK ASSESSOR CERTIFICATE EXPIRES  
8/23/2013**

This license issued under authority of the State  
of Illinois -Department of Public Health

This license is valid only when accompanied by  
a valid training course certificate

If found return to 525 W. Jefferson St Springfield, IL 62761



# HINDS ENVIRONMENTAL, INC.

Certifies that *Darrin Hinds*

has completed the requisite training for lead accreditation under USEPA entitled:  
**LEAD RISK ASSESSOR REFRESHER  
TRAINING COURSE**


in accordance with 40 CFR Part 745  
and successfully passed the exam with a score of 70% or above.

Course Date(s): August 26, 2010

Exam Date: August 26, 2010

Expiration Date: August 26, 2013

Certificate Number: RAR/0044



Course Instructor, Steve Honn

Accredited by the Illinois Department of Public Health  
2975 Stanton Street Springfield, Illinois 62703-4345 (217) 585-8970

**NITON**<sup>®</sup> corporation

# *Certificate of Achievement*

*This is to certify that*

**Darrin Hinds**

***Hinds Environmental Inc.***

*has successfully completed the Manufacturer's Training Course  
for the **NITON XL** Spectrum Analyzer*


*The one-day course covered radiation safety and monitoring,  
L x-ray measurement technology, and  
machine maintenance of the **XL** Lead-in-Paint Detector*

**V960904-19**

*Certificate Number*

**09/4/96-- Springfield, IL**

*Course Date & Site*

  
\_\_\_\_\_  
*Director of Training*

  
\_\_\_\_\_  
*President & CEO - NITON*

RE: Annual Medical Information

TO WHOM IT MAY CONCERN:

All Hinds Environmental, Inc. employees who perform project management, air monitoring or building inspection activities have annual medical examinations in accordance with OSHA.

According to the Health Insurance Portability and Accountability Act (HIPAA), medical information is to be kept confidential. This letter serves as documentation that the medical examinations on our employees are current and the complete exam reports are kept in confidential files at Hinds Environmental, Inc., 2975 Stanton Street, Springfield, IL 62703 (217-585-8970).

## RESPIRATOR TRAINING AND FIT TEST ACKNOWLEDGEMENT

Hinds Environmental, Inc.'s respirator protection program includes, but is not limited to the following components.

I acknowledge that I have received information on use of respiratory protection as contained in the EPA/NIOSH "Guide to Respiratory Protection for the Asbestos Abatement Industry" and OSHA respiratory protection requirements of 1910.134.

I acknowledge that I have participated in hands-on training in the use, limitations, and restrictions of respiratory protection.

I acknowledge that I have received information on the proper cleaning and maintenance of respiratory equipment.

---

---

NAME: Darrin Hinds DATE: 5-2-13

HALF FACE RESPIRATORY MANUFACTURER/TYPE: North

HALF FACE MODEL/APPROVAL #: 5500 Series SIZE: Medium


PAPR RESPIRATORY MANUFACTURER/TYPE: MSA


PAPR MODEL/APPROVAL #: UltraElite SIZE: Medium

TYPE OF TEST CONDUCTED: QUALITATIVE NEGATIVE PRESSURE

TESTING AGENT USED: IRRITANT SMOKE

TEST CONDUCTED BY: Steven Horn

SIGNATURE OF PERSON BEING FITTED: 

SIGNATURE OF PERSON CONDUCTING TEST: 



OFFICIAL USE ONLY - SECURITY RELATED INFORMATION

STATE OF ILLINOIS  
 ILLINOIS EMERGENCY MANAGEMENT AGENCY  
 DIVISION OF NUCLEAR SAFETY  
 1035 OUTER PARK DRIVE  
 SPRINGFIELD, ILLINOIS 62704  
 (217) 785-9947

**RADIOACTIVE MATERIAL LICENSE**

Pursuant to the Illinois Radiation Protection Act and the rules and regulations in 32 Illinois Administrative Code promulgated thereunder, and in reliance on statements and representations heretofore made by the licensee, a license is hereby issued authorizing the licensee to receive, acquire, own, possess and transfer radioactive material(s) listed herein; and to use such radioactive material(s) for the purpose(s) and at the place(s) designated below. This license is subject to all applicable rules, regulations and orders of the Agency now or hereafter in effect and to any conditions specified in the license.

<u>LICENSEE</u>	<u>LICENSE NUMBER</u>	<u>EXPIRATION DATE</u>
Hinds Environmental, Inc. 2975 Stanton Street Springfield, IL 62703	IL-01992-01	September 30, 2016
	<u>AMENDMENT NUMBER</u> 7	

Attention: Darrin Hinds  
 Radiation Safety Officer

In accordance with letter with attachment dated January 28, 2011, License Number IL-01992-01 is amended in its entirety. Previous amendments are void.

<u>ITEM</u>	<u>RADIONUCLIDE</u>	<u>CHEMICAL and/or PHYSICAL FORM</u>	<u>MAXIMUM ACTIVITY* PER SOURCE</u>	<u>MAXIMUM POSSESSION LIMIT</u>
A.	Cd-109	Sealed Sources - QSA Global, Inc. [formerly AEA Technology (Amersham)] Model CUC.D1 or CUC.P1; Isotope Products Laboratories Model XFB-3.	50 mCi	250 mCi

AUTHORIZED USE:

- A. For use in Thermo Niton Analyzers, LLC XLi Series and XLp Series x-ray fluorescence analyzers for measuring elemental content in various materials.

CONDITIONS

1. Radioactive material shall be used at the licensee's facilities located at 2975 Stanton Street, Springfield, Illinois and at temporary jobsites of the licensee in the State of Illinois in accordance with statements, representations and procedures listed in other conditions of this license.

\*  $\mu$ Ci-microcurie, mCi-millicurie; Ci-Curie; MBq-Megabecquerel; GBq-Gigabecquerel; TBq-Terabecquerel; g-gram;  $\mu$ g-microgram; kg-kilogram

<u>APPROVED BY:</u>	<u>DATE</u>	<u>PAGE of PAGES</u>
<i>Mary E. Burkhart</i> Mary E. Burkhart, Supervisor of Materials Licensing IL 473-0059	January 31, 2012	1 3

**OFFICIAL USE ONLY - SECURITY RELATED INFORMATION**

STATE OF ILLINOIS  
IEMA DIVISION OF NUCLEAR SAFETY  
RADIOACTIVE MATERIAL LICENSE

<u>LICENSEE</u>	<u>LICENSE NUMBER</u>	<u>AMENDMENT NUMBER</u>	<u>EXPIRATION DATE</u>
Hinds Environmental, Inc.	IL-01992-01	7	September 30, 2016

2. Radioactive material shall be used by, or under the supervision and in the physical presence of, Darrin Hinds, Steve Honn, or individuals who have successfully completed the manufacturer's training course or an equivalent Agency approved training course. The licensee shall maintain training records of all designated users.
3. The Radiation Safety Officer for this license is Darrin Hinds.
4.
  - A. Each sealed source possessed under this license shall be tested for leakage and/or contamination as specified in 32 Ill. Adm. Code 340.410. Tests for leakage and/or contamination shall be performed by persons specifically licensed to provide such services.
  - B. This license does not authorize analysis of leak test samples. However, the licensee is authorized to collect leak test samples for analysis by persons specifically authorized by the Agency, an Agreement State, or the U.S. Nuclear Regulatory Commission to perform such services.
5. Maintenance, repair and initial radiation monitoring of devices containing radioactive material shall be performed only by persons specifically authorized by the Agency, an Agreement State, or the Nuclear Regulatory Commission to perform such services.
6.
  - A. The source holder shall be locked in the "off" or closed position when the device is not in use.
  - B. Sealed sources shall not be opened or removed from their source holders by the licensee.
7. When performing tests at temporary job sites, the authorized user shall not leave the device unattended. Upon completion of tests, the device shall be locked in the licensee's vehicle or a secure building to prevent unauthorized use, loss, or theft.
8. At any time the licensee is engaged in making measurements by authority of this license at a temporary job site, the licensee shall have a current copy of each of the following documents available at the temporary job site for inspection by the Agency:
  - A. The license, including all active amendments;
  - B. The manufacturer's instruction manual for the sealed sources and devices at the temporary job site;
  - C. The licensee's emergency procedures; and
  - D. The results of the latest test for leakage and/or contamination performed on the sealed source.

\*  $\mu$ Ci-microcurie; mCi-millicurie; Ci-Curie; MBq-Megabecquerel; GBq-Gigabecquerel; TBq-Terabecquerel; g-gram;  $\mu$ g-microgram; kg-kilogram

<u>APPROVED BY:</u>	<u>DATE</u>	<u>PAGE</u>	<u>of</u>	<u>PAGES</u>
Mary E. Burkhardt, Supervisor of Materials Licensing IL 473-0059	January 31, 2012	2		3

OFFICIAL USE ONLY - SECURITY RELATED INFORMATION

STATE OF ILLINOIS  
IEMA DIVISION OF NUCLEAR SAFETY  
RADIOACTIVE MATERIAL LICENSE

<u>LICENSEE</u>	<u>LICENSE NUMBER</u>	<u>AMENDMENT NUMBER</u>	<u>EXPIRATION DATE</u>
Hinds Environmental, Inc.	IL-01992-01	7	September 30, 2016

9. Except as specifically provided otherwise by the license, the licensee shall possess and use radioactive material described in all schedules of this license in accordance with statements, representations and procedures contained in, referenced in, or enclosed with the documents listed below. The regulations contained in 32 Ill. Adm. Code: Chapter II, Subchapters b and d shall govern unless the statements, representations and procedures in the licensee's application and correspondence are more restrictive than the regulations. The most recent statements, representations and procedures listed below shall govern if they conflict with previously submitted documents.

A. Applications dated August 14, 2001 and January 28, 2011.

MEB:NL:bjc

\*  $\mu$ Ci-microcurie; mCi-millicurie; Ci-Curie; MBq-Megabecquerel; GBq-Gigabecquerel; TBq-Terabecquerel; g-gram;  $\mu$ g-microgram; kg-kilogram

APPROVED BY:

DATE

PAGE of PAGES

Mary E. Burkhart, Supervisor of Materials Licensing  
IL 475-0059

January 31, 2012

3 3